

### Fire Strategy & Fabric Improvement Notes

- Door Type I: upgrade thick existing historic door to be Certified FD30 Fire Door under BS 476: Part 22 (1987); carryout works in accordance with Drawing 331 and as per Note E.
- Door Type II: upgrade the fire resistance of existing historic doors, these doors have especially thin panel tongues and so cannot be certified to BS 476: Part 22 (1987); upgrade in accordance with drawing 332 and as per Note E and as follows:
- Door Type III: upgrade 30-35 mm thick existing door to be Certified FD30 Fire Door under BS 476: Part 22 (1987); execute works in accordance with drawing 333 and as per Note E.
- Door Type IV: Garret Double FD30 Fire Doors; the existing doors are to be retained and new FD30 fire doors are to be fitted within the frames. The doors are to be kept locked shut. Doors to meet BS 476: Part 22 (1987). Refer to Drawing 334
- Door Type V: Garret Single FD30 Fire Doors; the existing doors are to be retained and new FD30 fire doors are to be fitted within the frames. The doors are to be kept locked shut. Doors to meet BS 476: Part 22 (1987). Refer to Drawing 335.
- Door Type VI: double doors (DG23) to Room G04. This is a 44 mm thick existing door, upgrade in accordance with drawing 336 and as per Note E and in the following manner:  
- Carefully remove the modern glass from the fanlight and replace with fire resistant glass.
- Door Type VII: upgrade the fire resistance of existing historic doors (DF13), these doors have especially thin panel tongues and so cannot be certified to BS 476: Part 22 (1987); upgrade in accordance with drawing 337 and as per Note E and as follows:
- Door Type VIII: replace the existing modern flush door leaf with a new panelled FD30 door leaf in accordance with drawing 338.
- 
- Door Type X: New Steel Fire Door/Panel; this is to be fitted within the existing or adapted openings. Door rated to FD30 (30 minute fire resistance) to BS 476 Parts 20 & 22 and is fitted within a concrete block or existing masonry partition/opening.

- 
- Door Type XII: upgrade the fire resistance of existing historic doors, these doors have undetermined panel thickness and so may not be able to be certified to BS 476: Part 22 (1987); upgrade in accordance with drawing 342 and as per Note E and as follows:
- New infill partition. These are to be constructed on top of the existing masonry (lime & brick) walls to infill the gap. The partition is to be formed from either:  
A) brick and lime mortar  
B) timber studwork, infilled with rockwool (or similar) and clad with gypsum plasterboard such as Gyproc Fireline.
- Room with decorative silk flock wallpaper; this has been identified as a surface fire spread risk.
- Additional Fire Detector fitted to the Basement Room ceilings. Refer to the Mechanical & Electrical Engineer's Documentation.
- Basement room housing plant and operational equipment.
- Mess room; this room houses fire and security control equipment and user controls for the electrical system.
- Additional Fire Detector linked to the main system. These are to be fitted in a number of non-accessible spaces in addition to all rooms. These spaces include the basement, the void above the Great Hall and the Loft Spaces above the third floor. The basement detectors are readily accessible, the other detectors are accessible via floor or loft hatches. These are to detect a fire within these spaces. Refer to the Mechanical & Electrical Engineer's Documentation.
- Fire resistance partition; refer to Drawing 311. This is essentially a fire resistance board fixed within the existing opening with minimum intervention of the historic fabric.

### General Fire Strategy Notes

- The building is to be fitted with a new Fire Detection and Alarm system, this will be mains powered. Refer to M&E Engineer's documentation for details.
- All fire compartmentation lines are construction from masonry (assumed to be brick laid in lime mortar and plastered with lime or gypsum plaster). The walls are of solid construction and are of massive construction. Where existing or new interventions (such as wiring routes) penetrate the compartmentation lines, they are to be 'made good' using either lime mortar & brick, non-flammable material (rockwool) or intumescent material.
- The building's Fire Strategy relies upon EH staffing of the property. In event of a fire, the staff will act as Fire Wardens, they will direct people along the fire escape routes, check to ensure all persons have left the rooms and close all doors behind them. Where the doors are fire improved doors along compartmentation lines, these staff will ensure that these doors are firmly closed. This is all detailed with English Heritage's Staffing & Fire Strategy Document.
- Less-able visitors who cannot use stairs (such as wheelchair users) will be directed to 'Fire Refuge Zones' before being evacuated using 'Evac Chairs'. This is all detailed with English Heritage's Staffing & Fire Strategy Document.
- Details of the improvements to fire upgraded historic doors are to be found on the Door Type Drawings. Refer to Door Schedule 330.

DO NOT SCALE THIS DRAWING USE DIMENSIONS ONLY


VERIFY ALL DIMENSIONS ON SITE BEFORE COMMENCING ANY WORK OR SHOP DRAWINGS

INFORM THE ARCHITECT BEFORE ANY WORK STARTS IF THIS DRAWING EXCEEDS THE QUANTITIES IN ANY WAY


Revision	Date	Notes
A	19th June 2017	Proposals Amended
B	10th November 2017	Door Types Amended

### Drawing Key

- Line of Fire Compartment
- Fire Resistant Door
- Vertical Escape Route
- Horizontal Escape Route
- Door egressing into the open air
- Additional Fire Detector within void
- Space not open to the public. Either inaccessible or used for storage.
- Space used to house plant or electrical & mechanical control equipment
- Fire Refuge contained within a compartmented area.
- Room with a specific risk

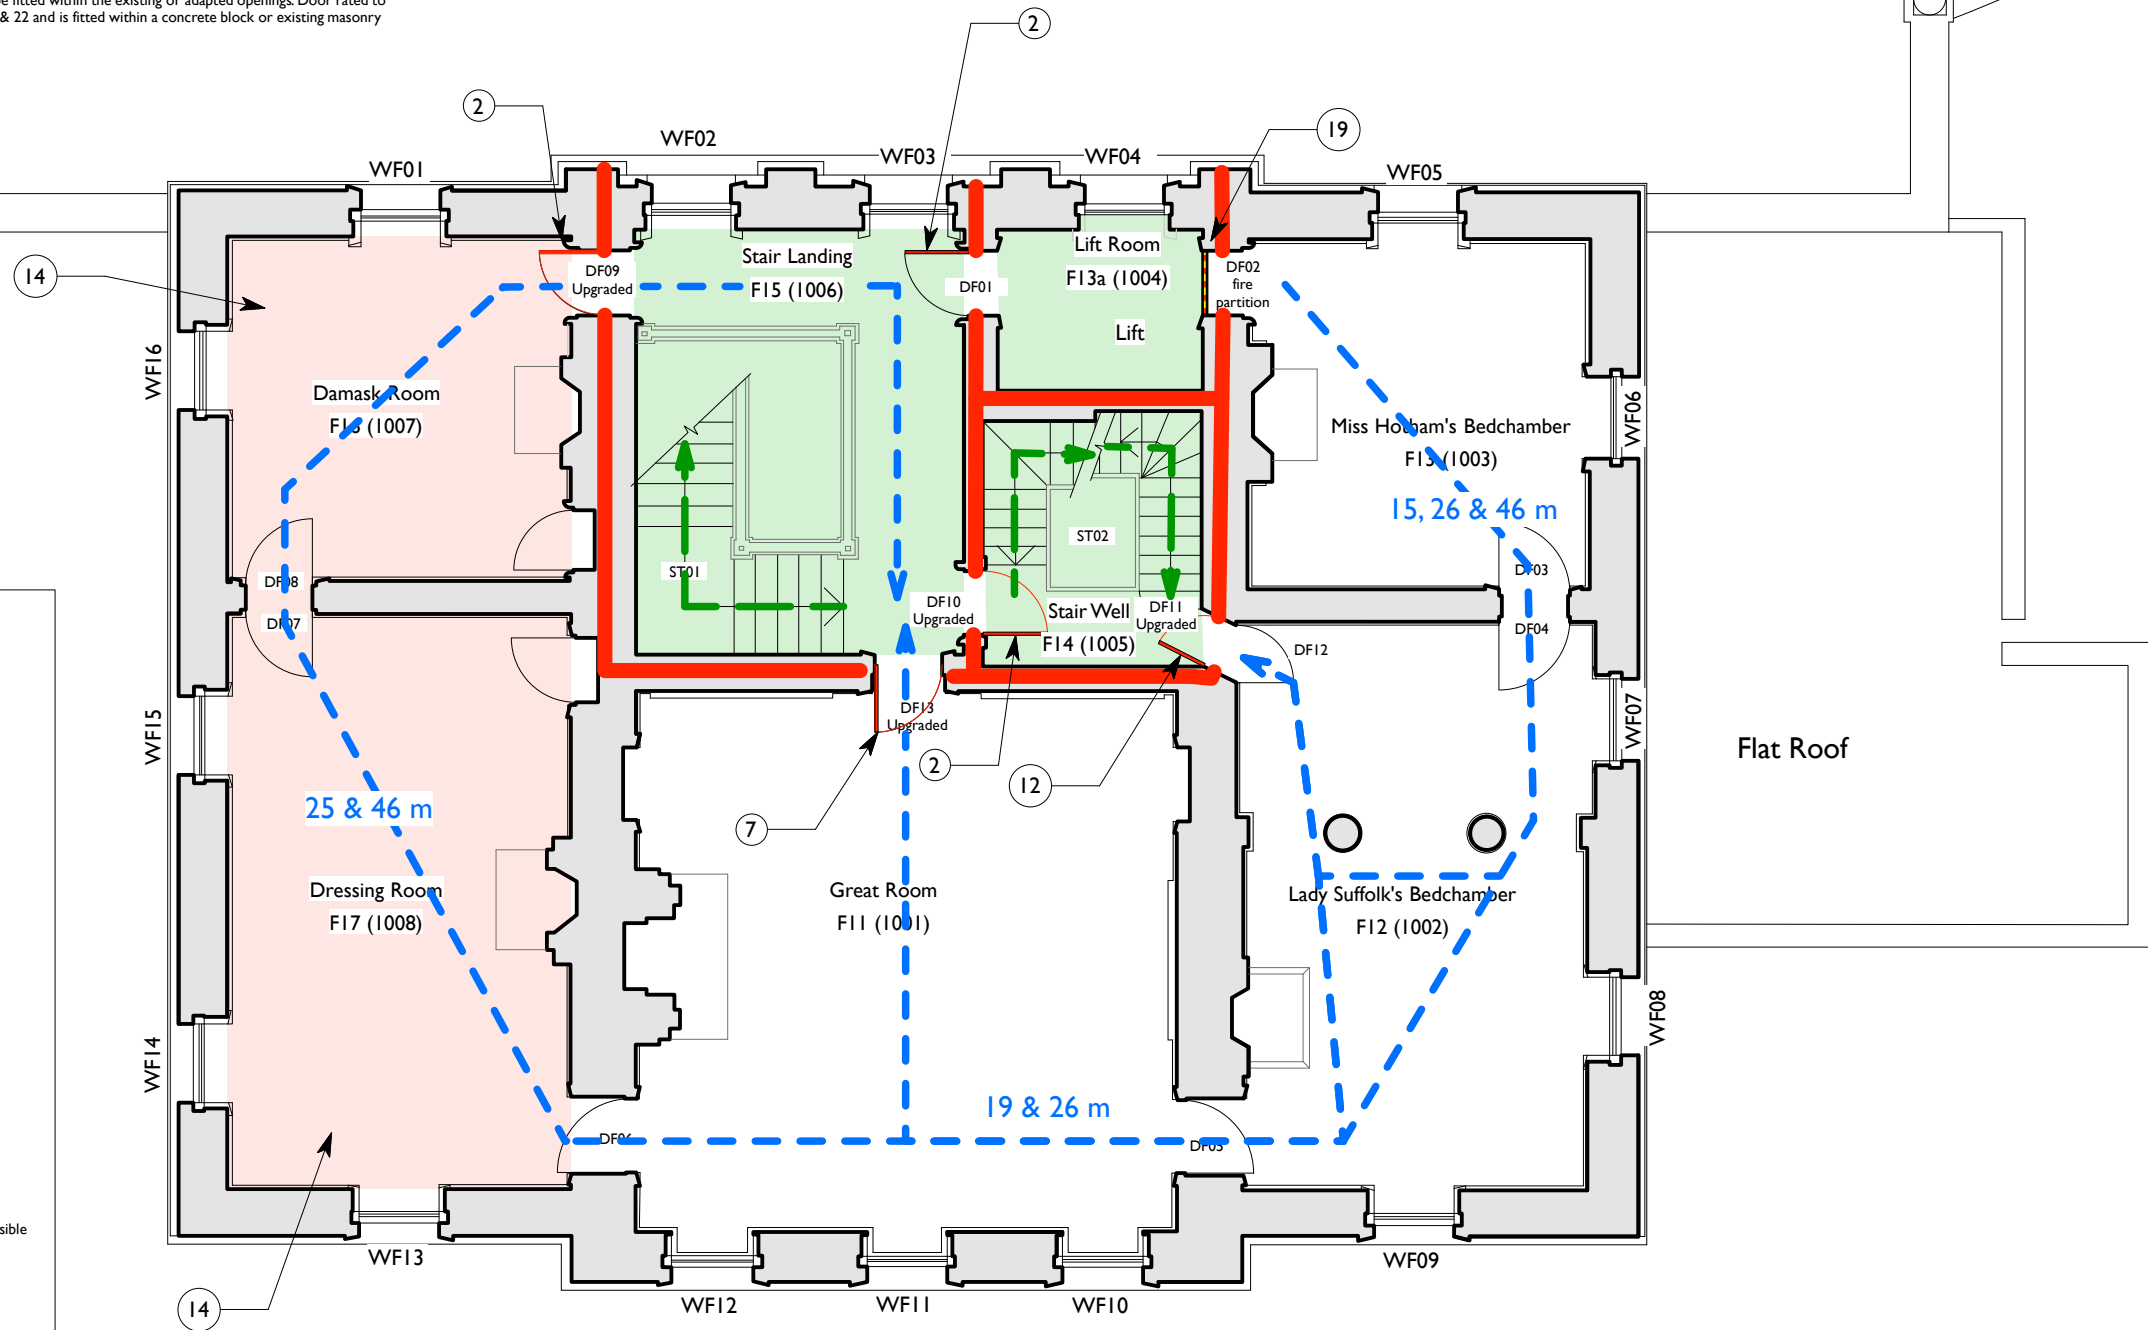

## First Floor Plan



DRAWING ISSUE STATUS	REVISION N°	DATE	SIGNED
RISK ASSESSMENT UNDERTAKEN			
PLANNING APPLICATION N° 1			
PLANNING APPLICATION N° 2			
PLANNING CONSENT			
LISTED BLDG APPLICATION			
LISTED BLDG CONSENT			
DAC APPROVAL			
BLDG CONTROL APPLICATION			
BLDG CONTROL APPROVAL			
TENDER DOCUMENT			
CONTRACT DOCUMENT			

CLIENT  
English Heritage

PROJECT  
Marble Hill House

TITLE  
Main House:  
First Floor Plan; Fire Strategy &  
Fabric Improvements

SCALE  
1:100 @ A3

DATE  
December 2016

JOB N°  
16\_132

DRAWN  
HS

DRAWING N°  
241 B



**Acanthus  
Clews  
architects**

Acanthus House  
57 Hightown Road  
Banbury • Oxfordshire  
OX16 9BE  
Tel: 01295 702600  
Fax: 01295 702601  
architects@acanthusclews.co.uk  
www.acanthusclews.co.uk