

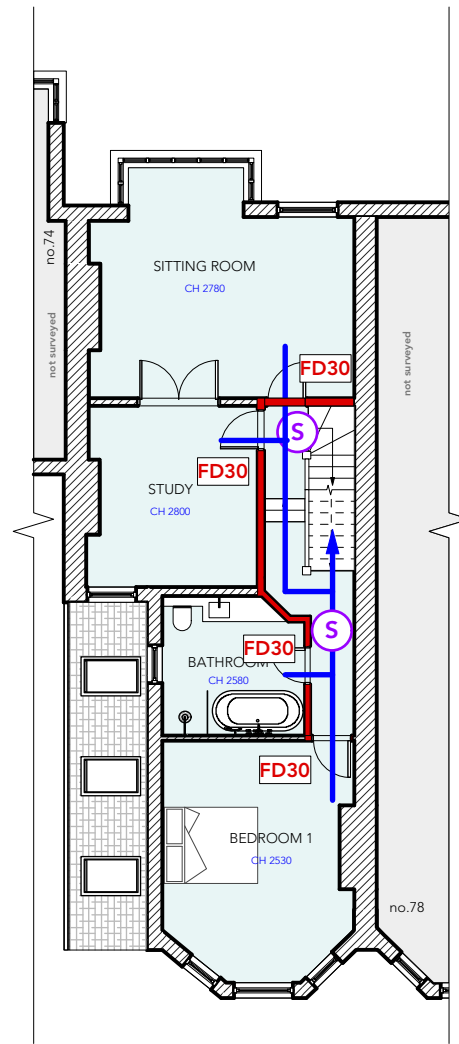


SIDE RETURN

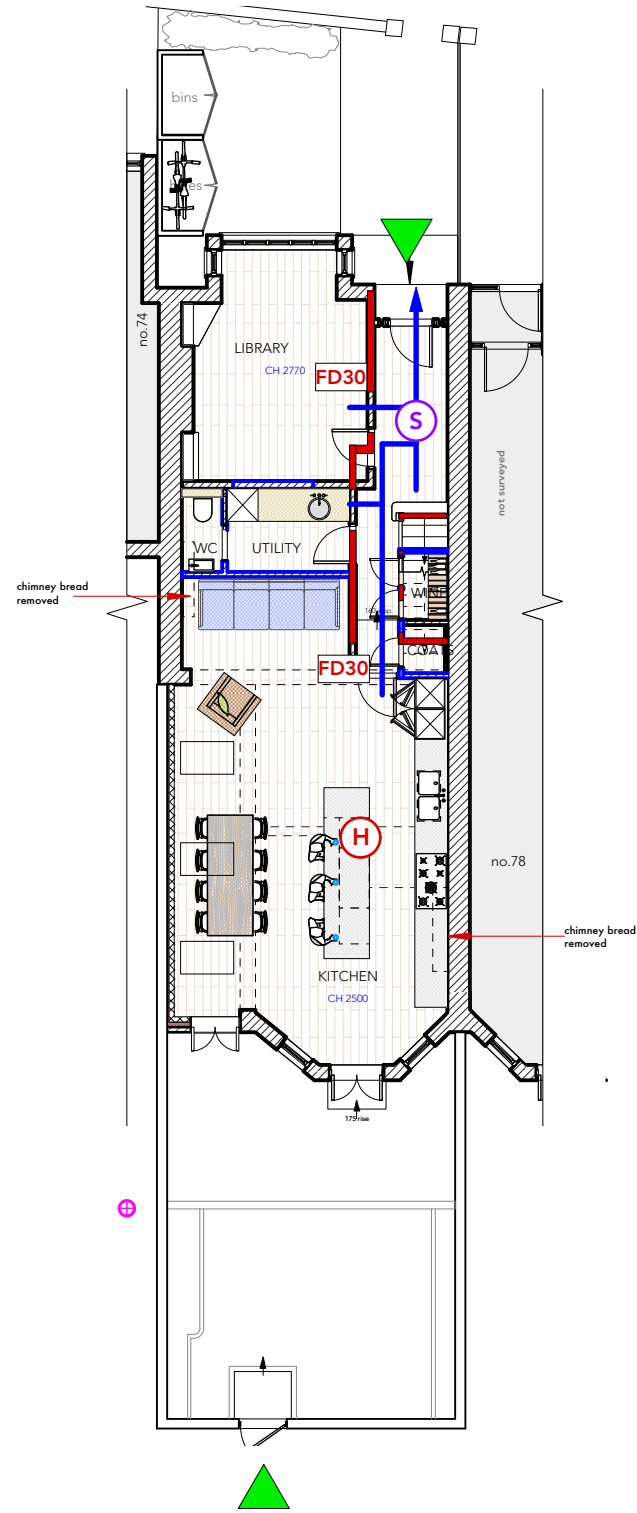

⊕
FIRST FLOOR

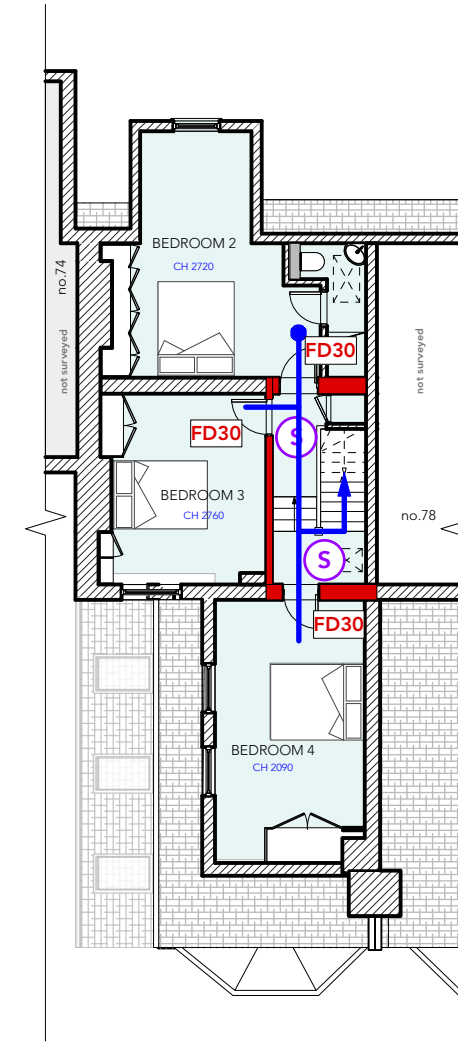

⊕
SECOND FLOOR

KEY

- Protected means of escape (walls and separating ceilings to be one hour fire resistant)
- Identified access points for firefighting staff
- Means of escape
- Heat detector
- Smoke detector
- All doors to be 30minutes fire rated
- Misting system (sprinklers)

WRITTEN DIMENSIONS ONLY TO BE USED ALL DIMENSIONS ARE IN MILLIMETRES ALL DIMENSIONS TO BE VERIFIED ON SITE ANY INCONSISTENCIES TO BE REPORTED TO THE ARCHITECT IMMEDIATELY	Job No: 7347 FOR PLANNING PURPOSES ONLY	p-ad 192D Campden Hill Road, Notting Hill Gate, London, W8 7TH t: 0208-4590172 e: ben@pelicanad.co.uk	p-ad
	76 Station Road London SW13 0LS	Title Drawn by BB	Proposed fire strategy 2 Scale 1:150 @A3