



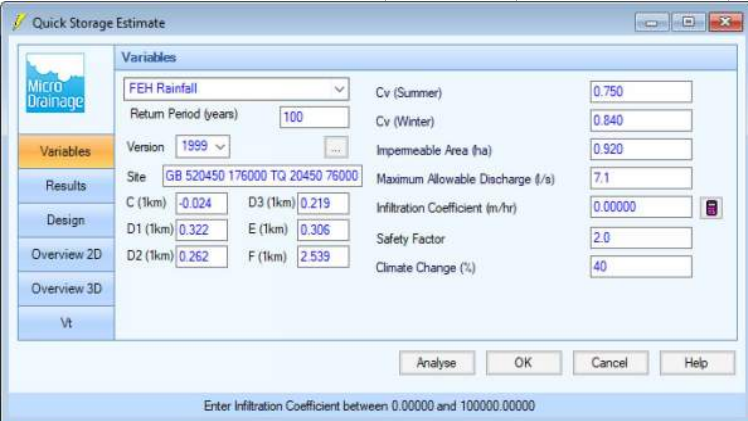
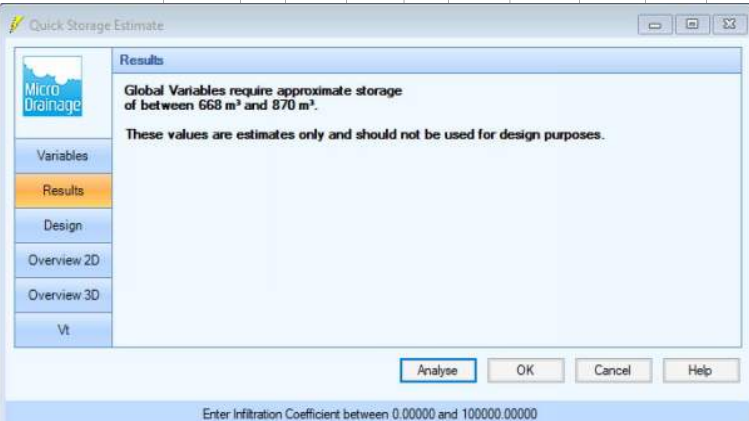
CALCULATIONS

Company: WIE
 Sheet No: 8 of 9
 By: S Whelan
 Checked: B McCarthy

Office: London
 Project No: WIE18671
 Date: 29/07/2022
 Date: 29/07/2022

Project Title Former Stag Brewery, Mortlake

Calculations Title Surface water attenuation volume to achieve IH124 greenfield runoff rate

LOCATION	CALCULATIONS										OPTIONS	
	In order to calculate the volume of surface water attenuation required for the Site, Windes Microdrainage version 2016.1, Source Control module, Quick Storage Estimate has been used. The input and output data for which are shown below;											
	Drainage Catchment - West 5											
	Area	0.92 ha										
	IH124 Greenfield Runoff Rate - Q10	7.73 l/s/ha										
	Maximum allowable discharge	7.14 l/s										
												
	50% attenuation volume (m ³)	NA										
	Greenfield attenuation volume (m ³)	769										



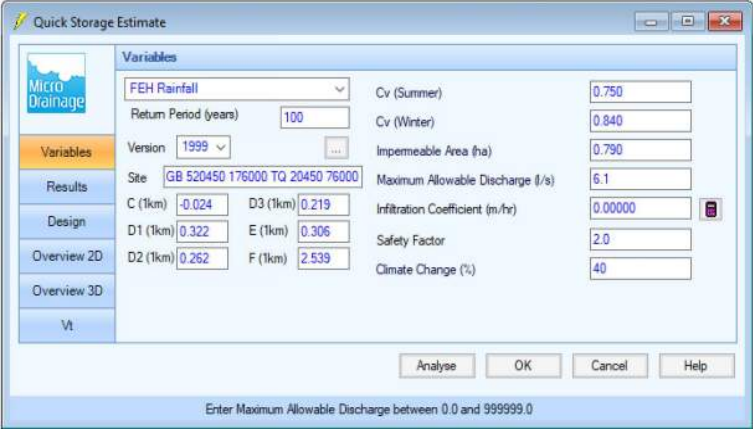
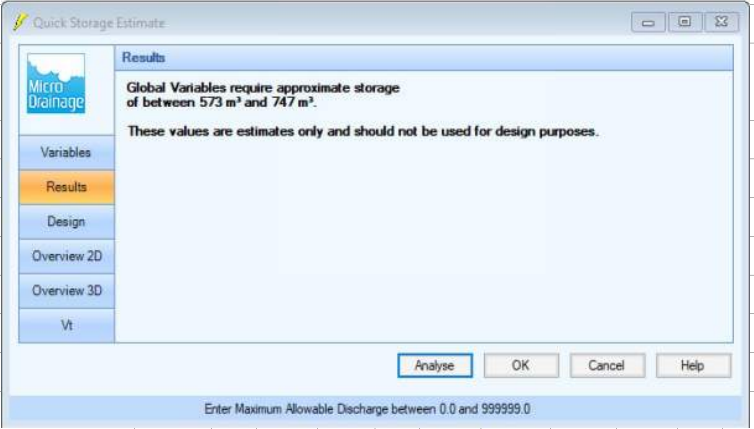
CALCULATIONS

Company: WIE
 Sheet No: 9 of 9
 By: S Whelan
 Checked: B McCarthy

Office: London
 Project No: WIE18671
 Date: 29/07/2022
 Date: 29/07/2022

Project Title Former Stag Brewery, Mortlake

Calculations Title Surface water attenuation volume to achieve IH124 greenfield runoff rate

LOCATION	CALCULATIONS										OPTIONS		
	In order to calculate the volume of surface water attenuation required for the Site, Windes Microdrainage version 2016.1, Source Control module, Quick Storage Estimate has been used. The input and output data for which are shown below;												
	Drainage Catchment - West 6												
	Area	0.79 ha											
	IH124 Greenfield Runoff Rate - Q10	7.73 l/s/ha											
	Maximum allowable discharge	6.11 l/s											
	 												
	50% attenuation volume (m ³)	177											
	Greenfield attenuation volume (m ³)	318.5											



I. Foul Flow Estimate

Appendices

The Former Stag Brewery, Mortlake

Project Number: WIE18671

Document Reference: WIE18671-104-R-11-4-1-DS



Project Title: **Stag Brewery**
 Calculations Title: **Existing Foul Flow Estimate**

Sheet No: 1 of 3 Project No: WIE18671
 By: M Stuart Date: 18/02/2022
 Checked: B McCarthy Date: 18/02/2022

	Dry Weather Flow Rate (per day)	Source	Number of	Factor	Profile (hours)	Peak Flow Rate (litres/second)
Residential				2.12	24	
Existing property = 160 litres/person/day	368.0 litres per unit	Thames Water Guidelines (2016)	0 existing units			0.0
New property = 125 litres/person/day	287.5 litres per unit	Thames Water Guidelines (2016)	0 proposed units			0.0
Occupancy = 2.3 persons						
Hotel	500.0 litres per room	British Water (2013)	15 rooms		3 24	0.3
Student Accommodation	200.0 litres per bed	Thames Water Guidelines (2016)	0 beds		3 24	0.0
Offices	750.0 litres per 100m ²	Jones (1992)	2318 m ²		3 10	1.4
Retail	400.0 litres per 100m ²	Jones (1992)	0 m ²		3 12	0.0
Cinema	10.0 litres per seat	Jones (1992)	0 seats*		3 8	0.0
Health Club/Sports Centre	50.0 litres per customer	British Water (2013)	168 customers**		3 16	0.4
Day School	90.0 litres per pupil	British Water (2013)	0 pupils		3 10	0.0
Boarding School	175.0 litres per pupil	British Water (2013)	0 pupils		3 24	0.0
Hospital	625.0 litres per bed	Jones (1992)	0 beds		3 24	0.0
Nursing Home	350.0 litres per bed	British Water (2013)	0 beds		3 24	0.0
Restaurant	30.0 litres per cover	British Water (2013)	0 covers		3 8	0.0
Pub/Club	15.0 litres per customer	Butler and Davies (2004)	0 customers***		3 12	0.0
Warehouse	150.0 litres per 100m ²	Jones (1992)	0 m ²		3 12	0.0
Manufacturing	550.0 litres per 100m ²	Jones (1992)	28671 m ²		3 12	11.0
Commercial	300.0 litres per 100m ²	Jones (1992)	0 m ²		3 12	0.0
SUB TOTAL						13.1
Infiltration percentage 10%						1.3
TOTAL						14.4

* Foul flow rate needs to be calculated based on number of seats. An allowance of 4m² has been made for each seat.

Floor area = 0 m² 4 m² per person

** Foul flow rate needs to be calculated based on number of customers. An allowance of 4m² has been made for each customer.

Floor area = 672 m² 4 m² per person

*** Foul flow rate needs to be calculated based on number of customers. An allowance of 4m² has been made for each customer.

Floor area = 0 m² 4 m² per person



Project Title: Stag Brewery
Calculations Title: Proposed Foul Flow Estimate

Sheet No: 2 of 2 Project No: WIE18671
 By: S Whelan Date: 02/08/2022
 Checked: B McCarthy Date: 02/08/2022

	Dry Weather Flow Rate (per day)	Source	Number of	Factor	Profile (hours)	Peak Flow Rate (litres/second)
Residential				2.12	24	
Existing property = 160 litres/person/day	400.0 litres per unit	Thames Water Guidelines (2016)	0 existing units			0.0
New property = 125 litres/person/day	312.5 litres per unit	Thames Water Guidelines (2016)	1071 proposed units			8.2
Occupancy = 2.5 persons						
Hotel	500.0 litres per room	British Water (2013)	15 rooms	3	24	0.3
Student Accommodation	200.0 litres per bed	Thames Water Guidelines (2016)	0 beds	3	24	0.0
Offices	750.0 litres per 100m ²	Jones (1992)	4468 m ²	3	10	2.8
Retail	400.0 litres per 100m ²	Jones (1992)	4782 m ²	3	12	1.3
Cinema	10.0 litres per seat	Jones (1992)	334 seats*	3	8	0.3
Health Club/Sports Centre	50.0 litres per customer	British Water (2013)	0 customers**	3	16	0.0
Day School	90.0 litres per pupil	British Water (2013)	1200 pupils	3	10	9.0
Boarding School	175.0 litres per pupil	British Water (2013)	0 pupils	3	24	0.0
Hospital	625.0 litres per bed	Jones (1992)	0 beds	3	24	0.0
Nursing Home	350.0 litres per bed	British Water (2013)	0 beds	3	24	0.0
Restaurant	30.0 litres per cover	British Water (2013)	0 covers	3	8	0.0
Pub/Club	15.0 litres per customer	Butler and Davies (2004)	0 customers***	3	12	0.0
Warehouse	150.0 litres per 100m ²	Jones (1992)	0 m ²	3	12	0.0
Manufacturing	550.0 litres per 100m ²	Jones (1992)	0 m ²	3	12	0.0
Commercial	300.0 litres per 100m ²	Jones (1992)	0 m ²	3	12	0.0
SUB TOTAL						21.9
Infiltration percentage 10%						2.2
TOTAL						24.1

* Foul flow rate needs to be calculated based on number of seats. An allowance of 4m² has been made for each seat.

Floor area = 1606 m² 4 m² per person

** Foul flow rate needs to be calculated based on number of customers. An allowance of 4m² has been made for each customer.

Floor area = 0 m² 4 m² per person

*** Foul flow rate needs to be calculated based on number of customers. An allowance of 4m² has been made for each customer.

Floor area = 0 m² 4 m² per person



Sheet No: 3 of 3 Project No: WIE18671
By: S Whelan Date: 02/08/2022
Checked: B McCarthy Date: 02/08/2022

Project Title: Stag Brewery
Proposed Foul Flow Estimate by development
Calculations Title: block

Description: **The proposed foul flows per development block have been calculated based on the number of residential units, commercial floor space, cinema seating, hotel rooms, and number of students attending the school, as captured within the proposed foul flow estimate calculation (Sheet 2 of 3) and the development proposals (Appendix A).**

Development Block	TW Manhole ref	Foul Flow (l/s)
1	4902	2.0
2	3005	1.1
3	4101	0.4
4	4101	0.3
5	4903	1.8
6	4901	0.3
7	4101	0.8
8	4101	0.9
9	6003	0.2
10	6901	0.3
11	6003	0.5
12	6003	0.5
13	3005	0.3
14	3901	0.3
15	3901	0.9
16	3007	0.6
17	3005	0.6
18	3007	0.9
19	3007	0.4
20	3007	0.1
21	3007	0.1
School	2801	9.0
Total	-	21.9



J. LBRuT SuDS Proforma

Appendices

The Former Stag Brewery, Mortlake

Project Number: WIE18671

Document Reference: WIE18671-104-R-11-4-1-DS

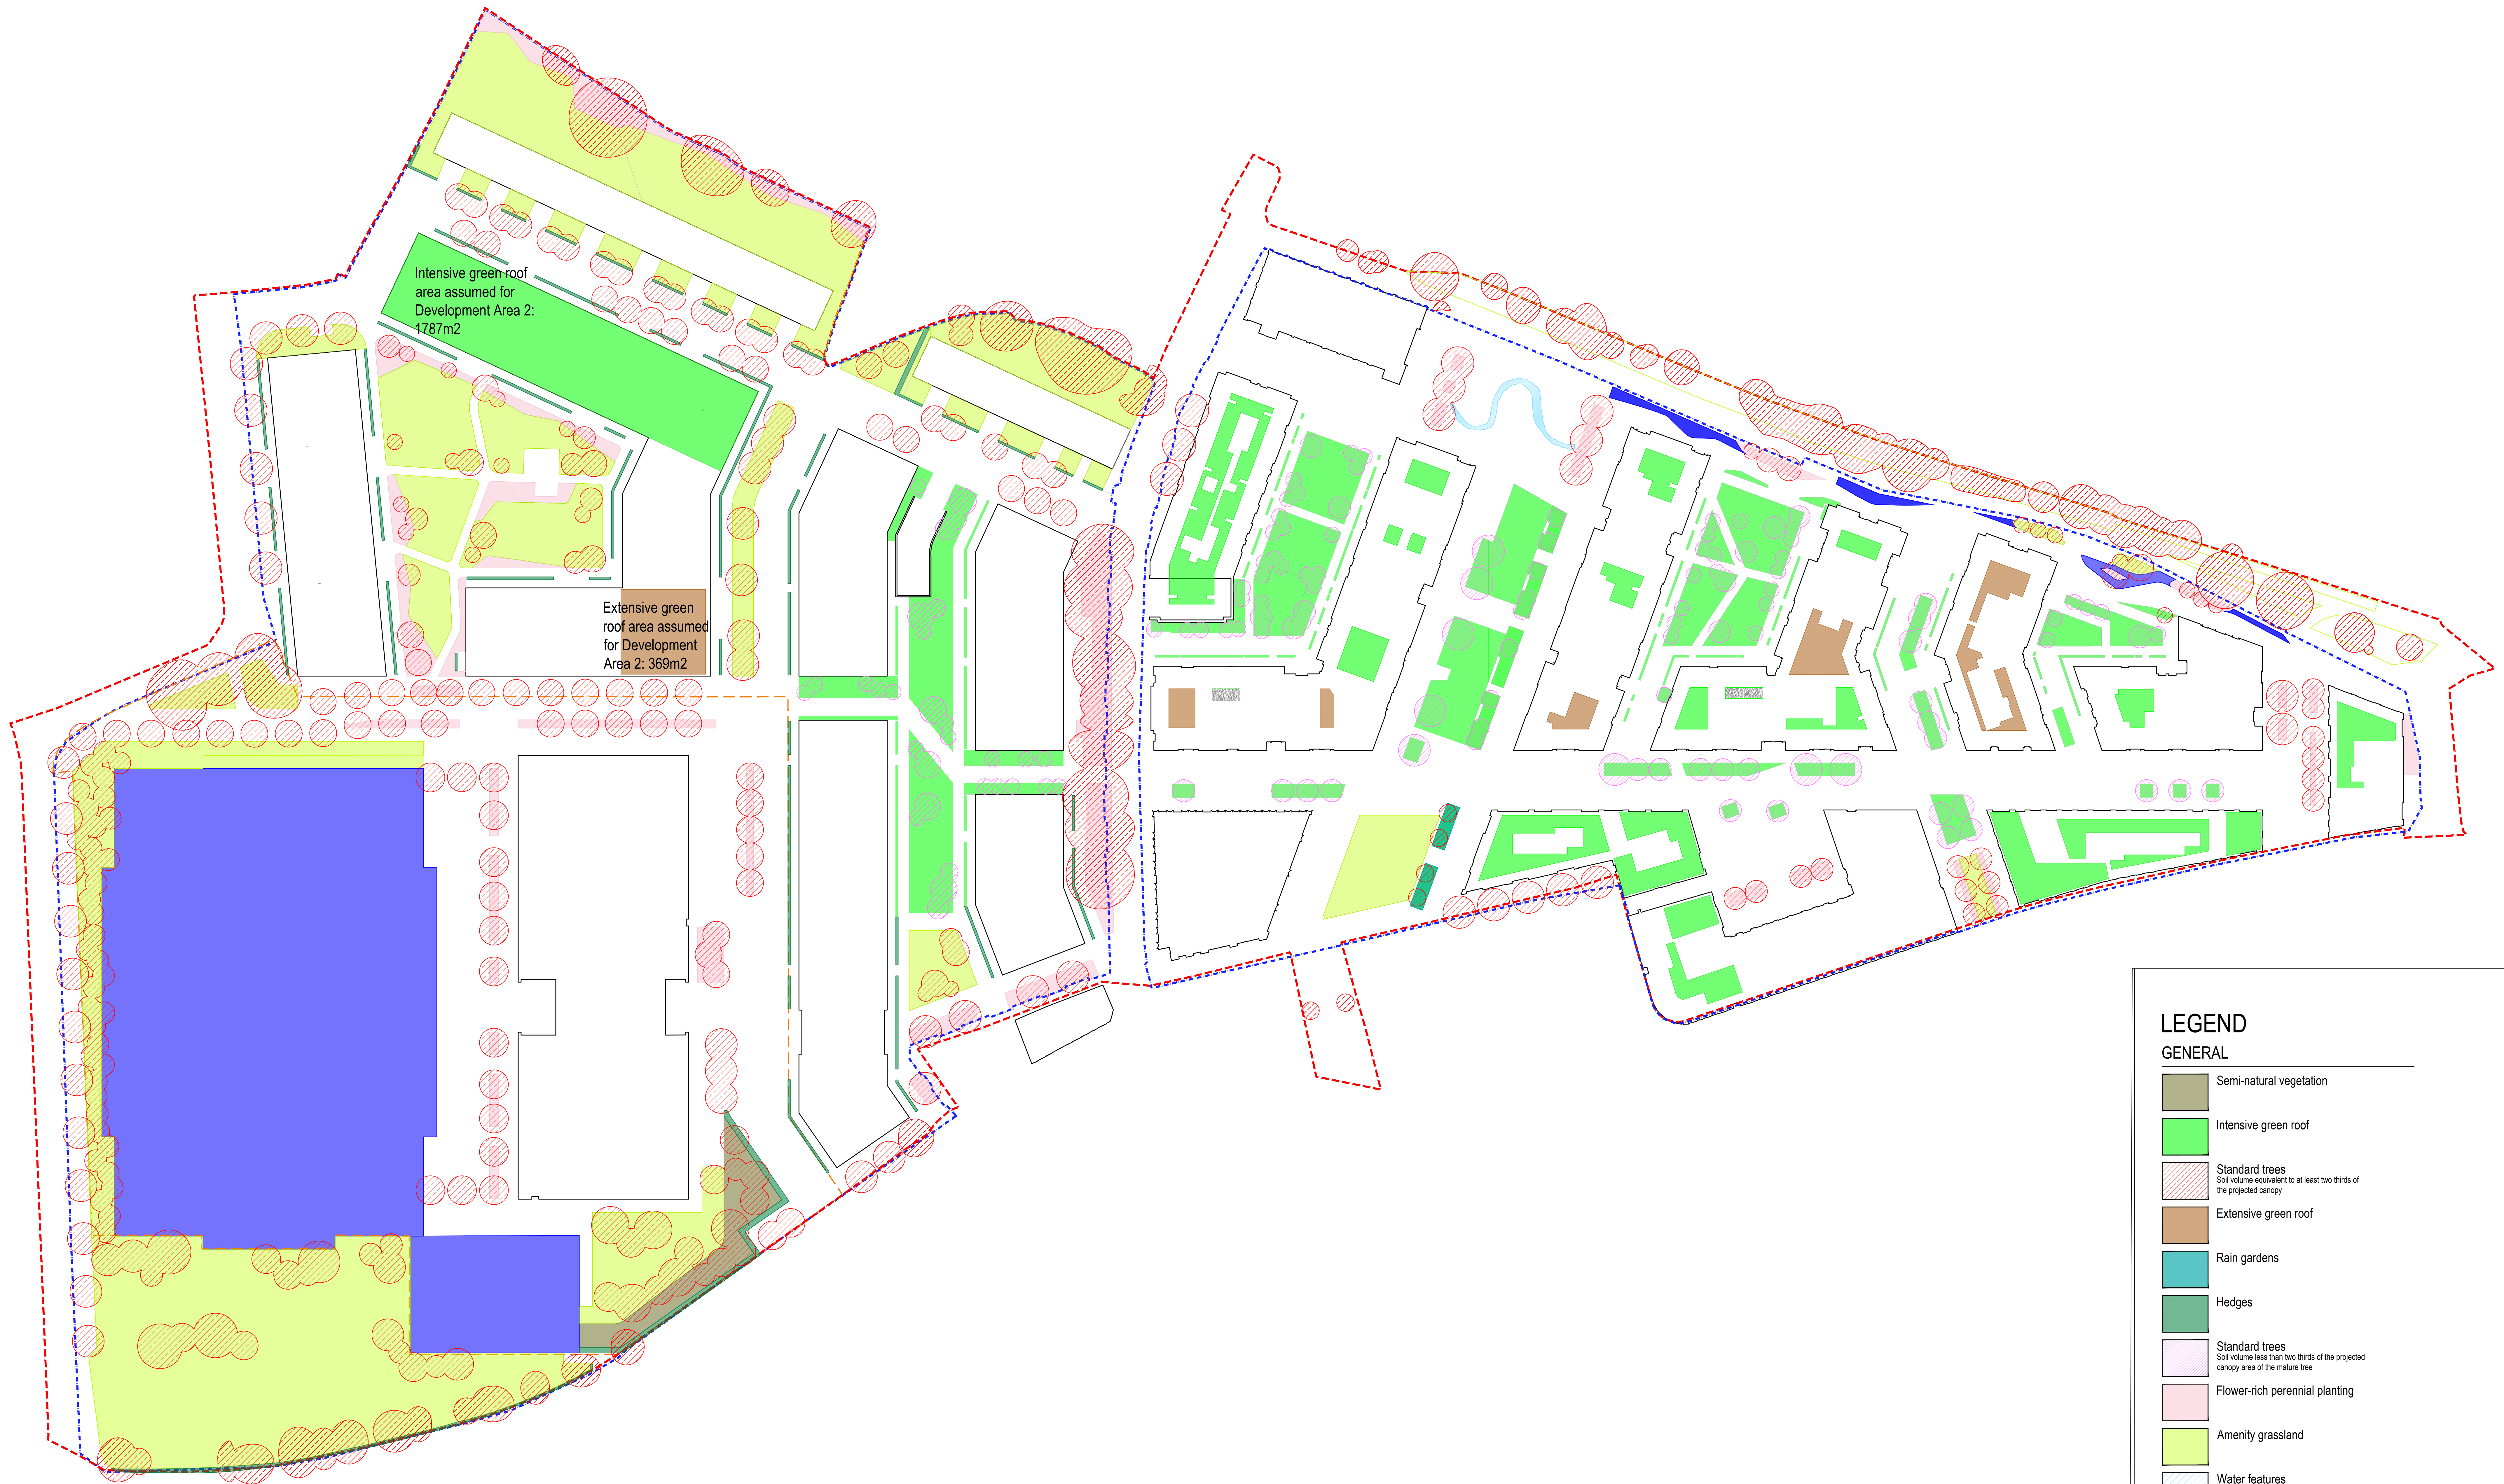
1. Project & Site Details	Project / Site Name (including sub-catchment / stage / phase where appropriate)	The Former Stag Brewery
	Address & post code	The Former Stag Brewery, Mortlake
	OS Grid ref. (Easting, Northing)	E 520470
		N 176018
	LPA reference (if applicable)	
	Brief description of proposed work	Section 1
	Total site Area	9941 m ²
	Total existing impervious area	5890 m ²
	Total proposed impervious area	5890 m ²
	Is the site in a surface water flood risk catchment (ref. local Surface Water Management Plan)?	See FRA
	Existing drainage connection type and location	Section 3
	Designer Name	Brendan McCarthy
	Designer Position	Technical Director
Designer Company	Waterman	

2. Proposed Discharge Arrangements	2a. Infiltration Feasibility		
	Superficial geology classification	Section 4	
	Bedrock geology classification	Section 4	
	Site infiltration rate	m/s	
	Depth to groundwater level	m below ground level	
	Is infiltration feasible?	Yes	
	2b. Drainage Hierarchy		
		<i>Feasible (Y/N)</i>	<i>Proposed (Y/N)</i>
	1 store rainwater for later use	Y	Y
	2 use infiltration techniques, such as porous surfaces in non-clay areas	N	
	3 attenuate rainwater in ponds or open water features for gradual release	N	
	4 attenuate rainwater by storing in tanks or sealed water features for gradual release	Y	Y
	5 discharge rainwater direct to a watercourse	Y	Y
	6 discharge rainwater to a surface water sewer/drain	Y	Y
	7 discharge rainwater to the combined sewer.	N	
	2c. Proposed Discharge Details		
	Proposed discharge location	Section 4	
Has the owner/regulator of the discharge location been consulted?	Section 4 and 5		

3a. Discharge Rates & Required Storage				
	Greenfield (GF) runoff rate (l/s)	Existing discharge rate (l/s)	Required storage for GF rate (m ³)	Proposed discharge rate (l/s)
Qbar	See Section 4			
1 in 1				
1 in 30				
1 in 100				
1 in 100 + CC				
Climate change allowance used		40%		
3b. Principal Method of Flow Control				
3c. Proposed SuDS Measures				
	Catchment area (m ²)	Plan area (m ²)	Storage vol. (m ³)	
Rainwater harvesting	See Section 4			
Infiltration systems				
Green roofs				
Blue roofs				
Filter strips				
Filter drains				
Bioretention / tree pits				
Pervious pavements				
Swales				
Basins/ponds				
Attenuation tanks				
Total	0	0	0	0

4a. Discharge & Drainage Strategy	Page/section of drainage report
Infiltration feasibility (2a) – geotechnical factual and interpretive reports, including infiltration results	Section 4
Drainage hierarchy (2b)	Section 4
Proposed discharge details (2c) – utility plans, correspondence / approval from owner/regulator of discharge location	Section 4
Discharge rates & storage (3a) – detailed hydrologic and hydraulic calculations	Section 4
Proposed SuDS measures & specifications (3b)	Section 4
4b. Other Supporting Details	Page/section of drainage report
Detailed Development Layout	Appendix E
Detailed drainage design drawings, including exceedance flow routes	Appendix E
Detailed landscaping plans	Appendix A
Maintenance strategy	Section 4
Demonstration of how the proposed SuDS measures improve:	Section 4
a) water quality of the runoff?	Section 4
b) biodiversity?	Section 4
c) amenity?	Section 4

K. Urban Greening Factor



Intensive green roof area assumed for Development Area 2: 1787m2

Extensive green roof area assumed for Development Area 2: 369m2

LEGEND

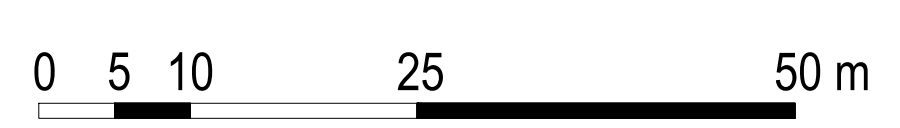

GENERAL

	Semi-natural vegetation
	Intensive green roof
	Standard trees Soil volume equivalent to at least two thirds of the projected canopy
	Extensive green roof
	Rain gardens
	Hedges
	Standard trees Soil volume less than two thirds of the projected canopy area of the mature tree
	Flower-rich perennial planting
	Amenity grassland
	Water features Chlorinated
	Permeable paving

rev	details	by	date
P00	Issued for planning submission	WQ	11.03.2022

Notes

1.0 Do not scale from drawing, use figured dimensions only
 1.1 All dimensions to be checked onsite
 1.2 This drawing to be read in conjunction with all other Gillespies drawings and specifications



Project title
STAG BREWERY

Drawing title
URBAN GREENING FACTOR - SITE WIDE

Drawing number P10736-00-004-GIL-0802	
Drawing Status PLANNING	Revision P00
Date 11.03.2022	Scale 1:500 @ AD
Drawn WQ	Checked JG

Client
DARTMOUTH CAPITAL
 Harwell House, 90-92 Salford Street, London E9 6JW

GILLESPIES
 1 St. John's Square, London, EC1M 4DH
 P 0207 2523292 E design.london@gillespies.co.uk

UK and Ireland Office Locations

