

MBCS ARCHITECTURAL SERVICES LIMITED  
 © This drawing is the copyright of MBCS ARCHITECTURAL SERVICES LIMITED. All dimensions and levels must be checked on site and verified prior to construction.  
 MBCS Architectural Services Limited,  
 Spaces, The Charter Building, Uxbridge, UB8 1JG  
 TEL: 07812072605  
 EMAIL: Markbretherton@mbs-as.co.uk  
 WEBSITE: www.mbs-as.co.uk

Client

Notes







Rev	Description	Date

Project  
**2 SHEEN PARK**  
**RICHMOND, TW9 1UW**

Drawing Title  
**FIRE STRATEGY DRAWING**



Drawn: MB	Date: 09.04.24
Scale: 1:100 @ A1	Revision: P1
Drawing Number: MBCS24-003/APL023	

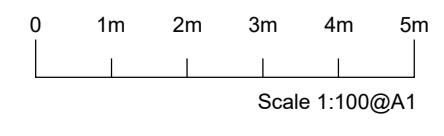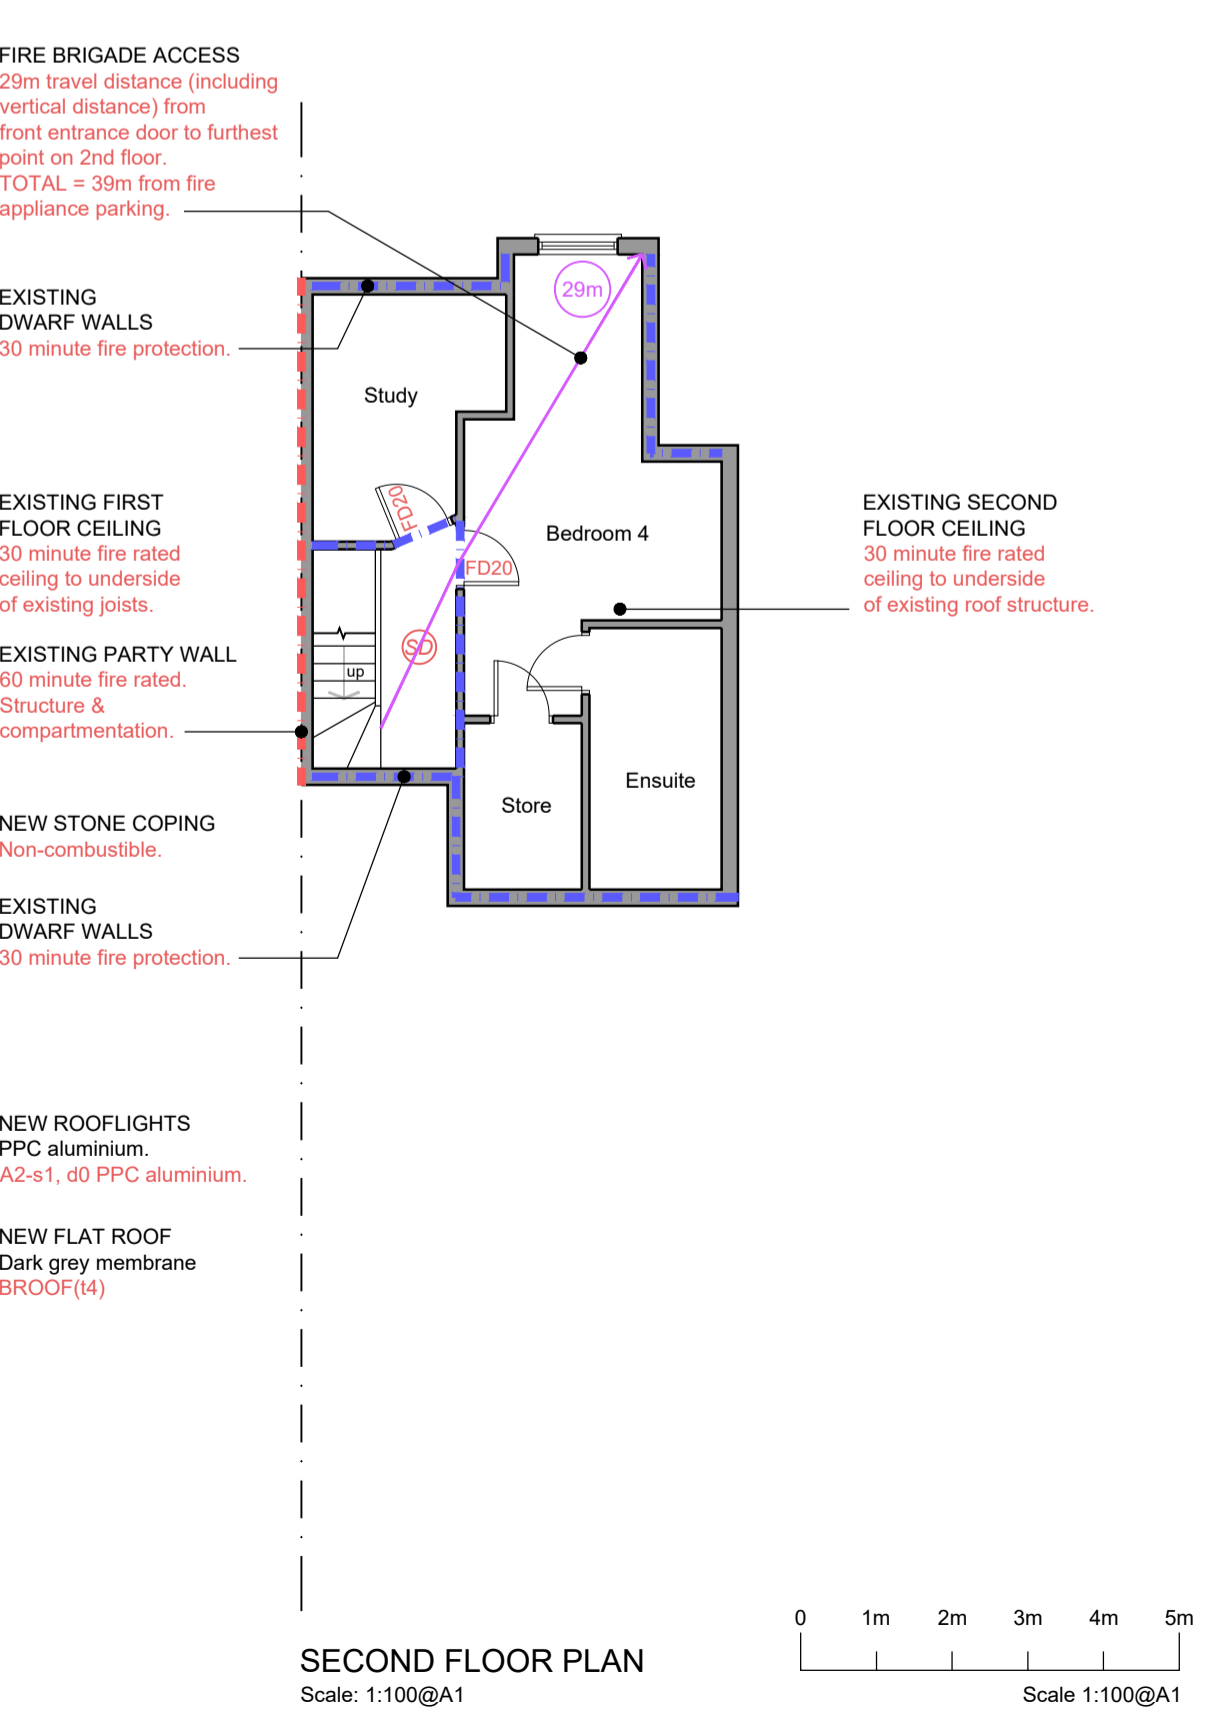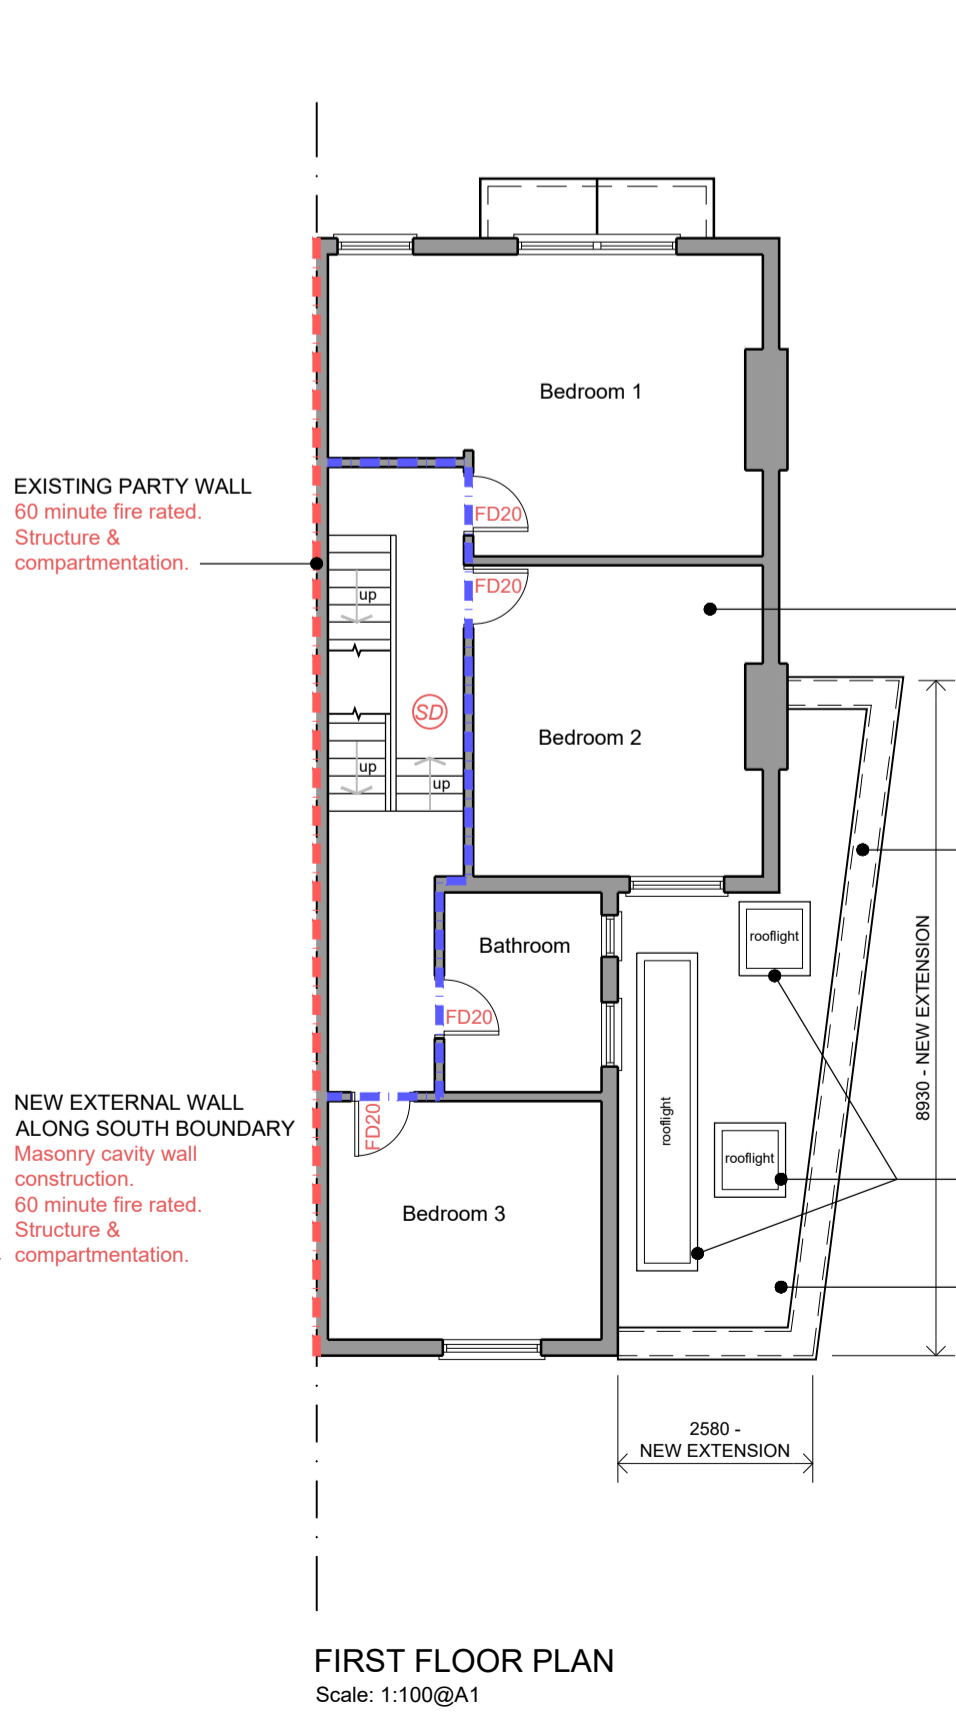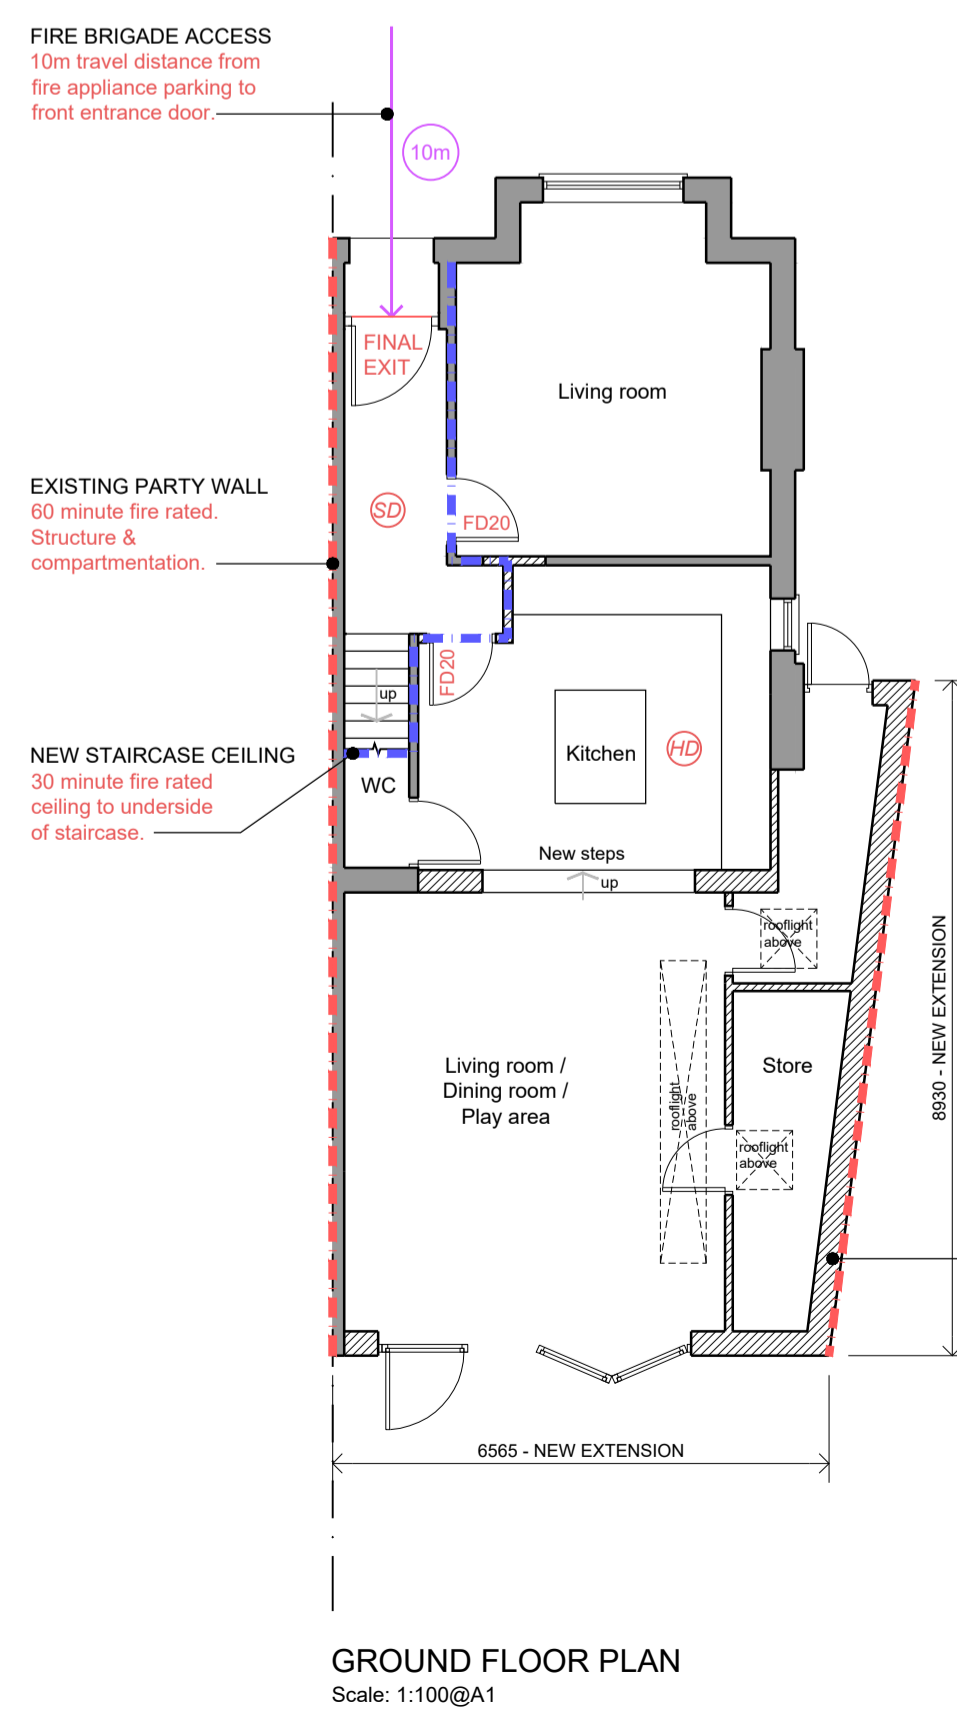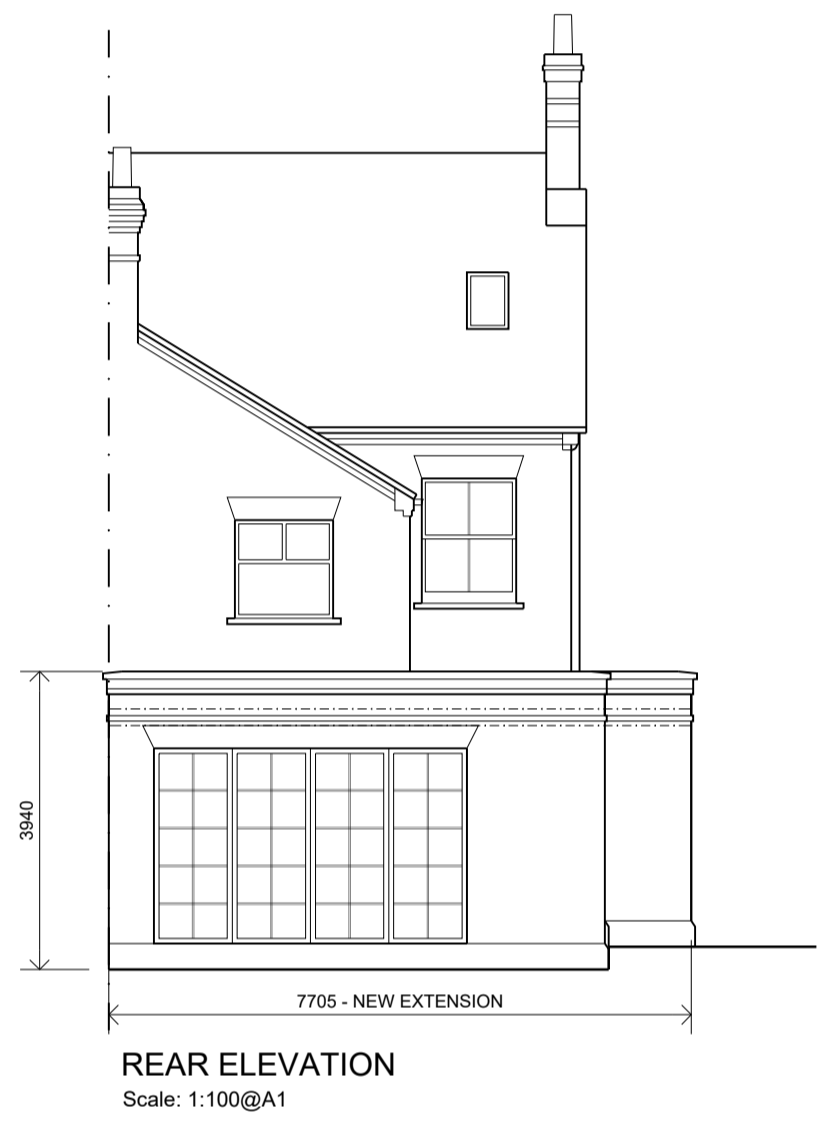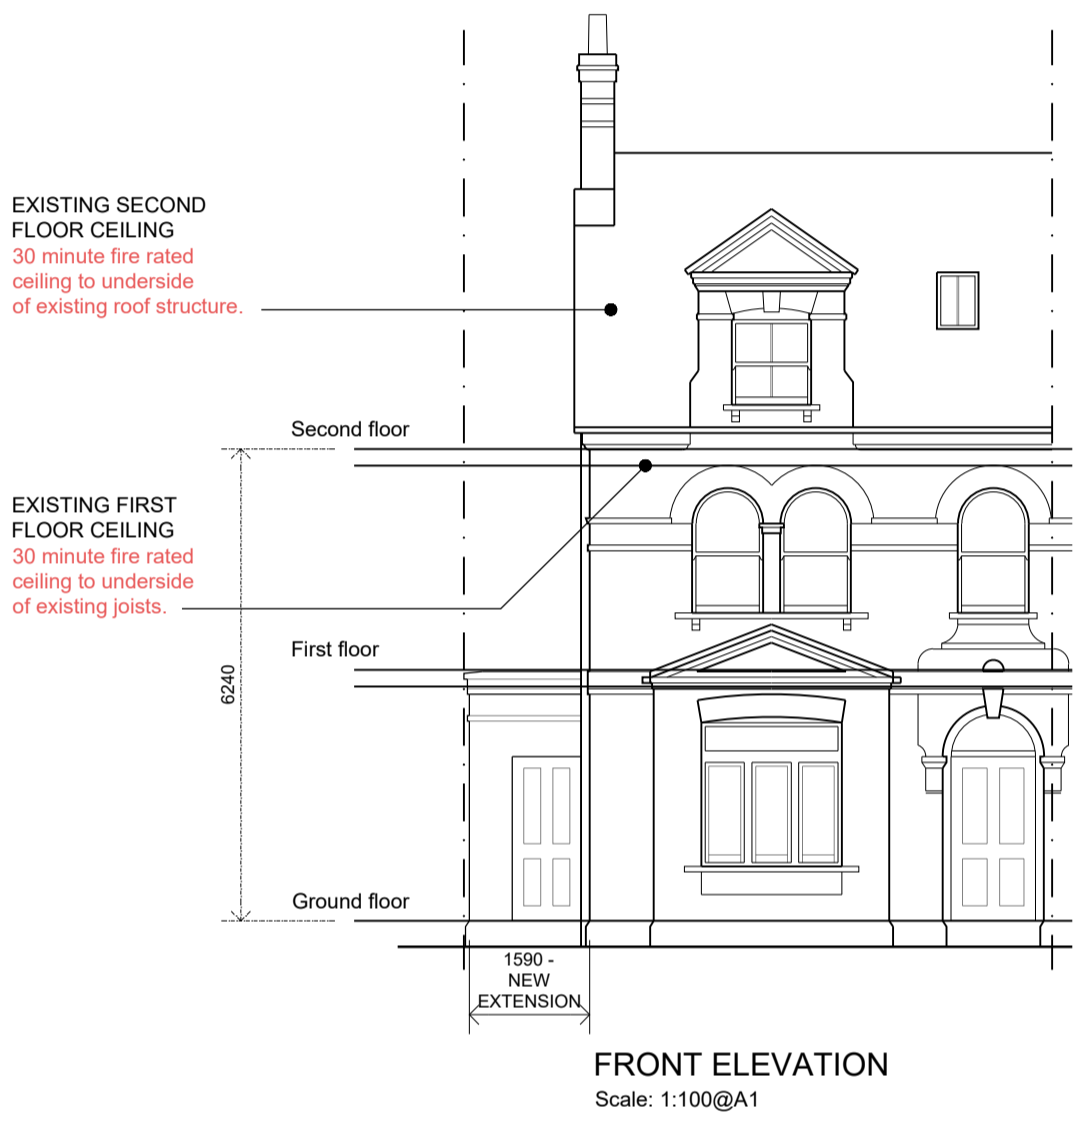

**LEGEND**

- Existing structure remaining.
- Existing structure removed.
- New structure.

**FIRE STRATEGY LEGEND & NOTES**

<b>30 MINUTE COMPARTMENTATION</b>	Min 30 minute fire resisting construction. Any service penetrations to be fire stopped and smoke sealed to min 30 minutes. Protected hallway walls taken up to underside of floor structure- All gaps to be packed with fire stopping material. Partitions to second floor to be taken up to ceiling level. Ceiling to provide 30 minute fire resistance.
<b>60 MINUTE COMPARTMENTATION</b>	Min 60 minute fire resisting construction. Any service penetrations to be fire stopped and smoke sealed to min 60 minutes. Party walls and compartment walls to be taken up to underside of roof covering. All gaps to be packed with fire stopping material.
<b>TRAVEL DISTANCE</b>	Travel distance (in meters).
<b>SD</b>	LD3 Grade D2 fire detection system to BS 5839-6. Smoke alarms to be interlinked mains powered with battery back up.
<b>FD</b>	LD3 Grade D2 fire detection system to BS 5839-6. Heat detectors to be interlinked mains powered with battery back up.
<b>FD** (S)</b>	Fire door rating, 20 = 20 minutes S = Smoke seal