



Air Conditioning
Technical Data

RXYSCQ-TV1



- > RXYSCQ4TMV1B
- > RXYSCQ5TMV1B
- > RXYSCQ6TMV1B

TABLE OF CONTENTS

RXYSCQ-TV1

1	Features	2
2	Specifications	3
	Technical Specifications	3
	Electrical Specifications	5
3	Options	6
4	Combination table	7
5	Capacity tables	9
	Capacity Table Legend	9
	Capacity Correction Factor	10
6	Dimensional drawings	12
7	Centre of gravity	13
8	Piping diagrams	14
9	Wiring diagrams	15
	Wiring Diagrams - Single Phase	15
10	External connection diagrams	16
11	Sound data	17
	Sound Power Spectrum	17
	Sound Pressure Spectrum	19
12	Installation	21
	Installation Method	21
	Refrigerant Pipe Selection	23
13	Operation range	25
14	Appropriate Indoors	26

1 Features

The most compact VRV

- Compact & lightweight single fan design makes the unit almost unnoticeable
- Covers all thermal needs of a building via a single point of contact: accurate temperature control, ventilation, air handling units and Biddle air curtains
- Wide range of indoor units: either connect VRV or stylish indoor units such as Daikin Emura, Nexura ...
- Incorporates VRV IV standards & technologies: Variable Refrigerant Temperature and full inverter compressors
- Customize your VRV for best seasonal efficiency & comfort with the weather dependant Variable Refrigerant Temperature function. Increased seasonal efficiency with up to 28%. No more cold draft by supply of high outblow temperatures
- VRV configurator software for the fastest and most accurate commissioning, configuration and customisation
- Possibility to limit peak power consumption between 30 and 80%, for example during periods with high power demand
- Connectable to all VRV control systems
- Keep your system in top condition via the Daikin Cloud Service: 24/7 monitoring for maximum efficiency, extented lifetime and immediate service support thanks to failure prediction



Inverter

2 Specifications

2-1 Technical Specifications					RXYSCQ4TV1	RXYSCQ5TV1	RXYSCQ6TV1
Recommended combination					3 x FXSQ25A2VEB + 1 x FXSQ32A2VEB	4 x FXSQ32A2VEB	2 x FXSQ32A2VEB + 2 x FXSQ40A2VEB
Cooling capacity	Prated,c			kW	12.1 (1)	14.0 (1)	15.5 (1)
Heating capacity	Prated,h			kW	8.4	9.7	10.7
	Nom.	6°CWB		kW	12.1 (2)	14.0 (2)	15.5 (2)
	Max.	6°CWB		kW	14.2 (2)	16.0 (2)	18.0 (2)
Power input - 50Hz	Heating	Nom.	6°CWB	kW	2.82 (2)	3.44 (2)	4.18 (2)
COP at nom. capacity	6°CWB			kW/kW	4.29	4.07	3.71
SEER					8.1	7.7	7.1
SCOP					4.6	4.7	
ηs,c				%	322.8	303.4	281.3
ηs,h				%	182.3	185.1	186.0
Capacity range				HP	4	5	6
Maximum number of connectable indoor units					64 (3)		
Indoor index connection	Min.				50.0	62.5	70.0
	Max.				130.0	162.5	182.0
Dimensions	Unit	Height		mm	823		
		Width		mm	940		
		Depth		mm	460		
	Packed unit	Height		mm	995		
		Width		mm	1,030		
		Depth		mm	580		
Weight	Unit			kg	89		
	Packed unit			kg	101		
Packing	Material				Carton		
	Weight			kg	3.8		
Packing 2	Material				Wood		
	Weight			kg	5.8		
Packing 3	Material				Plastic		
	Weight			kg	1.1		
Capacity control	Method				Inverter controlled		
Casing	Colour				Daikin White		
	Material				Painted galvanized steel plate		
Heat exchanger	Type				Cross fin coil		
	Indoor side				Air		
	Outdoor side				Air		
	Air flow rate	Cooling	Rated	m³/h	5,460		
		Heating	Rated	m³/h	5,460		
Compressor	Quantity				1		
	Type				Hermetically sealed swing compressor		
	Crankcase heater			W	33		
Fan	Quantity				1		
Fan motor	Quantity				1		
	Type				DC motor		
	Output			W	200		
Sound power level	Cooling	Nom.	dBA	68.0 (4)	69.0 (4)	70.0 (4)	
	Heating	Nom.	dBA	69.0 (4)	70.0 (4)	71.0 (4)	
Sound pressure level	Cooling	Nom.	dBA	51.0 (5)	52.0 (5)	53.0 (5)	
Operation range	Cooling	Min.~Max.		°CDB	-5.0~46.0		
	Heating	Min.~Max.		°CWB	-20.0~15.5		
Refrigerant	Type				R-410A		
	GWP				2,087.5		
	Charge			TCO ₂ eq	7.7		
				kg	3.7		
Refrigerant oil	Type				Synthetic (ether) oil FVC50K		

2 Specifications

2-1 Technical Specifications					RXYSCQ4TV1	RXYSCQ5TV1	RXYSCQ6TV1
Piping connections	Liquid	Type			Flare connection		
		OD	mm		9.52		
	Gas	Type			Flare connection		
		OD	mm		15.9	19.1	
Total piping length	System	Actual	m		300 (6)		
Defrost method					Reversed cycle		
Safety devices	Item	01			High pressure switch		
		02			Fan driver overload protector		
		03			Inverter overload protector		
		04			PC board fuse		
PED	Category				Category I		
	Most critical part	Name			Compressor		
		Ps*V	Bar*l		167		
Space cooling	A Condition (35°C - 27/19)	EERd			3.2	2.7	
		Pdc	kW		12.1	14.0	15.5
	B Condition (30°C - 27/19)	EERd			5.5	5.0	4.5
		Pdc	kW		8.9	10.3	11.4
	C Condition (25°C - 27/19)	EERd			11.4	10.5	8.9
		Pdc	kW		5.7	6.6	7.3
	D Condition (20°C - 27/19)	EERd			18.6	19.9	21.2
		Pdc	kW		4.8	4.9	5.0
Space heating (Average climate)	TBivalent	COPd (declared COP)			2.8	2.7	
		Pdh (declared heating cap)	kW		8.4	9.7	10.7
		Tbiv (bivalent temperature)	°C		-10		
	TOL	COPd (declared COP)			2.8	2.7	
		Pdh (declared heating cap)	kW		8.4	9.7	10.7
		Tol (temperature operating limit)	°C		-10		
	A Condition (-7°C)	COPd (declared COP)			3.2	3.1	
		Pdh (declared heating cap)	kW		7.4	8.5	9.5
	B Condition (2°C)	COPd (declared COP)			4.5		4.4
		Pdh (declared heating cap)	kW		4.5	5.2	5.8
	C Condition (7°C)	COPd (declared COP)			6.3	6.4	6.6
		Pdh (declared heating cap)	kW		3.4		3.7
	D Condition (12°C)	COPd (declared COP)			7.9	8.1	8.2
		Pdh (declared heating cap)	kW		4.0		
Cooling	Cdc (Degradation cooling)				0.25		
Heating	Cdh (Degradation heating)				0.25		
Power consumption in other than active mode	Crankcase heater mode	Cooling	PCK	kW	0.000		
		Heating	PCK	kW	0.049		
	Off mode	Cooling	POFF	kW	0.039		
		Heating	POFF	kW	0.049		
	Standby mode	Cooling	PSB	kW	0.039		
		Heating	PSB	kW	0.049		
	Thermostat-off mode	Cooling	PTO	kW	0.000		
		Heating	PTO	kW	0.049		
Indication if the heater is equipped with a supplementary heater					no		
Supplementary heater	Back-up capacity	Heating	elbu	kW	0.0		

Standard Accessories : Installation manual; Quantity : 1;

Standard Accessories : Operation manual; Quantity : 1;

Standard Accessories : Connection pipes; Quantity : 1;

2 Specifications

2-2 Electrical Specifications				RXYSCQ4TV1	RXYSCQ5TV1	RXYSCQ6TV1
Power supply	Name		V1			
	Phase		1~			
	Frequency	Hz	50			
	Voltage	V	220-240			
Voltage range	Min.	%	-10			
	Max.	%	10			
Current	Nominal running current (RLA) - 50Hz	Cooling	A	19.0 (7)		23.2 (7)
Current - 50Hz	Starting current (MSC) - remark			(8)		
	Zmax	List		No requirements		
	Minimum circuit amps (MCA)		A	29.1 (9)		
	Maximum fuse amps (MFA)		A	32 (10)		
	Total overcurrent amps (TOCA)		A	29.1 (11)		
	Full load amps (FLA)	Total	A	0.6 (12)		
Wiring connections - 50Hz	For power supply	Quantity	3G			
	For connection with indoor	Quantity	2			
		Remark	F1,F2			
Power supply intake			Both indoor and outdoor unit			

Notes

- (1) Cooling: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB; equivalent piping length: 7.5m; level difference: 0m
- (2) Heating: indoor temp. 20°CDB; outdoor temp. 7°CDB, 6°CWB; equivalent refrigerant piping: 7.5m; level difference: 0m
- (3) Actual number of units depends on the indoor unit type (VRV DX indoor, RA DX indoor, etc.) and the connection ratio restriction for the system (being; $50\% \leq CR \leq 130\%$).
- (4) Sound power level is an absolute value that a sound source generates.
- (5) Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to the sound level drawings.
- (6) Refer to refrigerant pipe selection or installation manual
- (7) RLA is based on following conditions: indoor temp. 27°CDB, 19°CWB; outdoor temp. 35°CDB
- (8) MSC means the maximum current during start up of the compressor. VRV IV uses only inverter compressors. Starting current is always \leq max. running current.
- (9) MCA must be used to select the correct field wiring size. The MCA can be regarded as the maximum running current.
- (10) MFA is used to select the circuit breaker and the ground fault circuit interrupter (earth leakage circuit breaker).
- (11) TOCA means the total value of each OC set.
- (12) FLA means the nominal running current of the fan
- Cooling: T1: indoor temp. 26,7°CDB, 19,4°CWB, outdoor temp. 35°CB, AHRI 1230:2010, power input indoor units (duct type) included
- Cooling: T3: indoor temp. 29,0°CDB, 19,0°CWB, outdoor temp. 46°CB, ISO15042:2011, power input indoor units (duct type) included
- Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CB, AHRI 1230:2010, power input indoor units (duct type) included
- In accordance with EN/IEC 61000-3-12, it may be necessary to consult the distribution network operator to ensure that the equipment is connected only to a supply with $S_{sc} \geq$ minimum S_{sc} value
- Maximum allowable voltage range variation between phases is 2%.
- Voltage range: units are suitable for use on electrical systems where voltage supplied to unit terminal is not below or above listed range limits.
- The automatic ESEER value corresponds with normal VRV IV-S heat pump operation, including the advanced energy saving functionality (variable refrigerant temperature control).
- The standard ESEER value corresponds with normal VRV IV-S heat pump operation, not taking into account the advanced energy saving functionality.
- Sound values are measured in a semi-anechoic room.
- EN/IEC 61000-3-12: European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current $I > 16A$ and $\leq 75A$ per phase
- S_{sc} : Short-circuit power
- For detailed contents of standard accessories, see installation/operation manual

3 Options

3 - 1 Options

3

RXYSCQ-TV1

**VRV4-S
Heat pump
Option list**

Nr.	Item	RXYSCQ4~6TMV1B	RXYSQ4~6T7V1B RXYSQ4~6T8VB(9)	RXYSQ4~6T7Y1B RXYSQ4~6T8YB(9)	RXYSQ8~12TMY1B	RXYSQ6T7Y1B9 RXYSQ6T8Y1B9	RXYSQ6TMYFK
I.	Refnet header	KHRQ22M29H					
		-	-	-	KHRQ22M64H	-	KHRQ22M64H
II.	Refnet joint	KHRQ22M20T					
		-	-	-	KHRQ22M29T9	-	KHRQ22M29T9
		-	-	-	KHRQ22M64T	-	KHRQ22M64T
1a.	Cool/heat selector (switch)	-	KRC19-26		-	KRC19-26	-
1b.	Cool/heat selector (fixing box)	-	KJB111A		-	KJB111A	-
1c.	Cool/heat selector (PCB)	-	EBRP2B	-	-	-	-
1d.	Cool/heat selector (cable)	-	-	EKCHSC	-	EKCHSC	-
2.	Drain plug kit	-	EKDK04		-	EKDK04	-
3.	VRV configurator	EKPCCB*					
4.	Demand PCB	DTA104A61/62*					
5.	Branch provider - -2- rooms	BPMKS967A2				-	-
6.	Branch provider - -3- rooms	BPMKS967A3				-	-

Notes

- All options are kits
- To mount option -1a-, option -1b- is required.
- For -RXYSCQ4~6T7V1B-
For -RXYSCQ4~6T8VB-
To operate the cool/heat selector function, options -1a- and -1c- are both required.
- For -RXYSCQ4~6T7Y1B-
For -RXYSCQ4~6T8YB-
To operate the cool/heat selector function, options -1a- and -1d- are both required.

3D097778E

4 Combination table

4 - 1 Combination Table

RXYSCQ-TV1

VRV4-S
Heat pump
·RA/SA DX· indoor unit
Compatibility list

Configuration		Indoor unit type	
·RA· indoor unit	Wall-mounted	<i>Emura</i>	FTXJ20M (W/S)
			FTXJ25M (W/S)
			FTXJ35M (W/S)
			FTXJ50M (W/S)
		<i>FTXM</i>	FTXM20N
			FTXM25N
			FTXM35N
			FTXM42N
			FTXM50N
			FTXM60N
			FTXM71N
		<i>CTXM</i>	CTXM15M
		<i>Stylish</i>	FTXA20
	FTXA25		
	FTXA35		
	FTXA42		
	FTXA50		
	Floor-standing	<i>Flex</i>	FLXS25B
	Ceiling-mounted		FLXS35B
			FLXS50B
FLXS60B			
Floor-standing	<i>FVXM</i>	FVXM25F	
		FVXM35F	
		FVXM50F	
	<i>Nexura</i>	FVXG25K	
		FVXG35K	
		FVXG50K	
Duct	<i>FDXM</i>	FDXM25F	
		FDXM35F	
		FDXM50F	
		FDXM60F	

Configuration		Indoor unit type	
·SA· indoor unit	Cassette	<i>Fully Flat 2x2</i>	FFA25A
			FFA35A
			FFA50A
		<i>Roundflow 3x3</i>	FFA60A
			FCAG35A
			FCAG50A
	Ceiling-suspended		FHA35A
			FHA50A
			FHA60A
			FHA71A
	Duct		FBA35A
			FBA50A
			FBA60A
		FBA71A	
Floor-standing	<i>FNA</i>	FNA25A	
		FNA35A	
		FNA50A	
		FNA60A	

Remark

1. The limitations on the use of ·RA/SA· indoor units with the ·VRV4-S· Heat Pump are subject to the rules set out in drawings ·3D097983· and ·3D097984·.

3D097777E

RXYSCQ-TV1

VRV4-S
Heat pump
Indoor unit combination restrictions

Indoor unit combination pattern	·VRV* DX· indoor unit	·RA DX· indoor unit	Hydrobox unit	Air handling unit (AHU) ⁽¹⁾
·VRV* DX· indoor unit	O	X	X	O
·RA DX· indoor unit	X	O	X	X
Hydrobox unit	X	X	X	X
Air handling unit (AHU) ⁽¹⁾	O	X	X	O ₁

O: Allowed
X: Not allowed

Notes

- O₁
 - Combination of ·AHU· only + control box ·EKEQFA· (not combined with ·VRV DX· indoor units)
 - ·X·-control is possible [-EKEV+EKEQFA*· boxes]. No Variable Refrigerant Temperature control possible.
 - ·Y·-control is possible [-EKEV+EKEQFA*· boxes]. No Variable Refrigerant Temperature control possible.
 - ·W·-control is possible [-EKEV+EKEQFA*· boxes]. No Variable Refrigerant Temperature control possible.
 - Combination of ·AHU· only + control box ·EKEQMA· (not combined with ·VRV DX· indoor units)
 - Z-control is possible (the allowed number of [-EKEV + EKEQMA· boxes] is determined by the connection ratio (-90-110%·) and the capacity of the outdoor unit.
- Combination of ·AHU· and ·VRV DX· indoor units
 - Z-control is possible (-EKEQMA*· boxes are allowed, but with a limited connection ratio).
- (1) The following units are considered AHUs:
 - ·EKEV + EKEQ(MA/FA) + AHU· coil
 - ·Biddle· air curtain
 - ·FXMQ_MF· units

Information

·VKM· units are considered regular ·VRV DX· indoor units.

3D097983A

4 Combination table

4 - 1 Combination Table

4

RXYSCQ-TV1

VRV4-S

Heat pump

Indoor unit combination restrictions

Combination table	RXYSCQ4~6TMV1B	RXYSQ4~6T7V1B	RXYSQ4~6T7Y1B	RXYSQ8~12TMY1B
·VRV* DX· indoor unit	O	O	O	O
·RA DX· indoor unit	O	O	O	O
Hydrobox unit	X	X	X	X
Air handling unit (AHU) ⁽²⁾	O	O	O	O

O: Allowed

X: Not allowed

Notes

(2) The following units are considered AHUs:

- ·EKEV + EKEQ(MA/FA) + AHU· coil
- ·Biddle· air curtain
- ·FXMQ_MF· units

3D097983A

RXYSCQ-TV1

Unit combination restrictions: ·VRV4· outdoor units (all models) + ·15·-class indoor units

Units in scope: ·FXZQ15A· and ·FXAQ15A·.

1. In case the system contains these indoor units and the total connection ratio (-CR-) ≤ ·100·%: no special restrictions. Follow the restrictions that apply to regular ·VRV DX· indoor units.
2. In case the system contains these indoor units and the total connection ratio (-CR-) > ·100·%: special restrictions apply.
 - A. When the connection ratio (-CR1) of the sum of all ·FXZQ15A· and/or ·FXAQ15A· units in the system ≤ ·70·%, and ALL other ·VRV DX· indoor units have an individual capacity class > ·50·: no special restrictions.
 - B. When the connection ratio (-CR1) of the sum of all ·FXZQ15A· and/or ·FXAQ15A· units in the system ≤ ·70·%, and NOT ALL other ·VRV DX· indoor units have an individual capacity class > ·50·: the restrictions below apply.
 - * 100% < CR ≤ 105% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·70·%.
 - * 105% < CR ≤ 110% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·60·%.
 - * 110% < CR ≤ 115% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·40·%.
 - * 115% < CR ≤ 120% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·25·%.
 - * 120% < CR ≤ 125% -> ·CR1· of the sum of all ·FXZQ15A· and/or ·FXAQ15A· indoor units in the system must be ≤ ·10·%.
 - * 125% < CR ≤ 130% -> ·FXZQ15A· and ·FXAQ15A· cannot be used.

Remark

Only the ·15·-class indoor units explicitly mentioned on this page are in scope. Other indoor units follow the rules that apply to regular ·VRV DX· indoor units.

3D104665A

5 Capacity tables

5 - 1 Capacity Table Legend

In order to fulfill more your requirements on quick access of data in the format you require, we have developed a tool to consult capacity tables.

Below you can find the link to the capacity table database and an overview of all the tools we have to help you select the correct product:

- **Capacity table database:** lets you find back and export quickly the capacity information you are looking for based upon unit model, refrigerant temperature and connection ratio.
- You can access the capacity table viewer here:

https://my.daikin.eu/content/denv/en_US/home/applications/software-finder/capacity-table-viewer.html



- An overview of **all software tools** that we offer can be found here:

https://my.daikin.eu/denv/en_US/home/applications/software-finder.html



5 Capacity tables

5 - 2 Capacity Correction Factor

5

RXYSCQ-TV1

MINI VRV

Integrated heating capacity coefficient

The heating capacity tables do not take into account the capacity reduction in case of frost accumulation or defrost operation.

The capacity values that take these factors into account, or in other words, the integrated heating capacity values, can be calculated as follows:


Formula

- A = Integrated heating capacity
- B = Capacity characteristics value
- C = Integrated correction factor for frost accumulation (see table)

$$A = B * C$$

Inlet air temperature of heat exchanger

[°CDB/°CWB]	-7/-7.6	-5/-5.6	-3/-3.7	0/-0.7	3/2.2	5/4.1	7/6
RXYSCQ4TMV1B							
RXYSCQ5TMV1B							
RXYSCQ6TMV1B							
RXYSQ4T7V1B							
RXYSQ5T7V1B							
RXYSQ6T7V1B							
RXYSQ4T7Y1B							
RXYSQ5T7Y1B							
RXYSQ6T7Y1B							
RXYSQ6T7Y1B9							
RXYSQ4T8VB							
RXYSQ5T8VB	0,88	0,86	0,80	0,75	0,76	0,82	1,00
RXYSQ6T8VB							
RXYSQ4T8YB							
RXYSQ5T8YB							
RXYSQ6T8YB							
RXYSQ6T8Y1B9							
RXYSQ4T8VB9							
RXYSQ5T8VB9							
RXYSQ6T8VB9							
RXYSQ4T8YB9							
RXYSQ5T8YB9							
RXYSQ6T8YB9							
RXYSQ8TMY1B	0,95	0,93	0,88	0,84	0,85	0,90	1,00
RXYSQ10TMY1B	0,95	0,93	0,87	0,79	0,80	0,88	1,00
RXYSQ6TMYFK							
RXYSQ12TMY1B	0,95	0,92	0,87	0,75	0,76	0,85	1,00

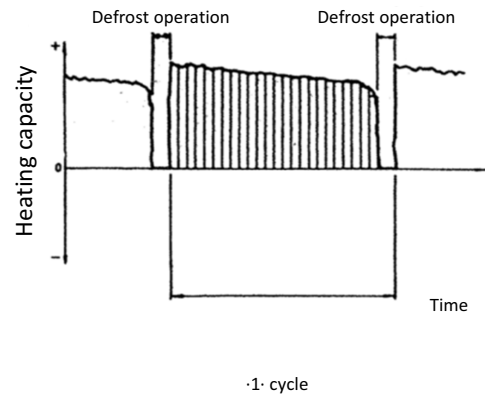

Notes


- (1) The figure shows the integrated heating capacity for a single cycle (from one defrost operation to the next).
- (2) When there is an accumulation of snow against the outdoor unit heat exchanger, there will always be a temporary reduction in capacity depending on the outdoor temperature (°C DB), relative humidity (RH) and the amount of frosting which occurs.

3D094659D

5 Capacity tables

5 - 2 Capacity Correction Factor

RXYSCQ4-5TV1

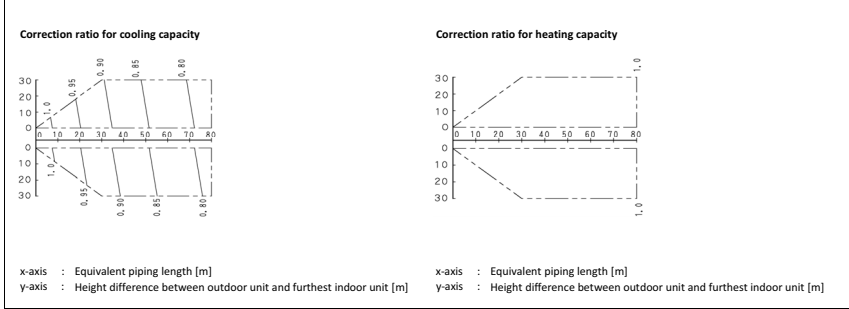

Mini VRV
Correction factor

Notes

1. These figures illustrate the capacity correction factor due to the piping length for a standard indoor unit system at maximum load (with the thermostat set to maximum), under standard conditions.

Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, as shown in the above figures.

2. With this outdoor unit, the following control is used:
- in case of cooling: constant evaporating pressure control

3. **Method of calculating the capacity of the outdoor units.**

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is less.

Indoor connection ratio ≤ 100%.

Maximum capacity of outdoor units = Capacity of outdoor units from capacity table at 100% connection ratio. × Correction ratio of piping to furthest indoor unit

Indoor connection ratio > 100%.

Maximum capacity of outdoor units = Capacity of outdoor units from capacity table at installed connection ratio. × Correction ratio of piping to furthest indoor unit

4. When the overall equivalent piping length is 90 m or more, the diameter of the main gas pipes (outdoor unit - branch sections) must be increased.
For the new diameters, see below.


Model	Standard liquid side Ø	Increased liquid side Ø	Standard gas side Ø	Increased gas side Ø
RXYSCQ4TMV1B	9,5	Not increased	15,9	19,1
RXYSCQ5TMV1B				

5. Overall equivalent length

Overall equivalent length = Equivalent length of the main pipe × Correction factor + Equivalent length of the branch pipes

Choose the correction factor from the following table.
When calculating the cooling capacity: gas pipe size
When calculating the heating capacity: liquid pipe size

	Standard size	Size increase
Cooling (gas pipe)	1,0	0,5
Heating (liquid pipe)	1,0	0,5



Overall equivalent length


- Cooling mode = 80 m x 0,5 + 40 m = 80 m
- Heating mode = 80 m x 0,5 + 40 m = 80 m

Capacity correction ratio (height difference = 0)

- Cooling mode = 0,78
- Heating mode = 1,0

3D094660D

RXYSCQ6TV1

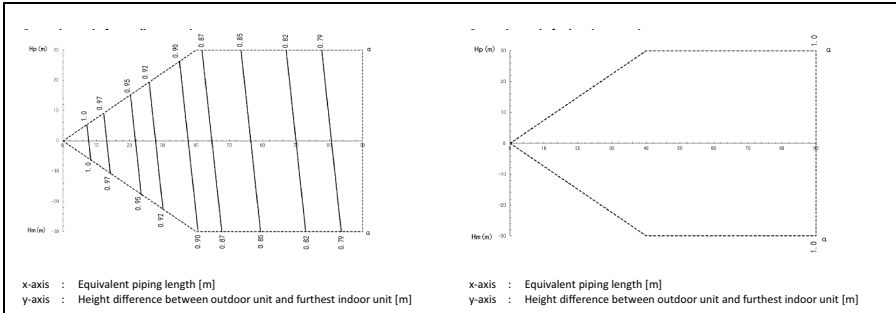

Mini VRV
Correction factor

Notes

1. These figures illustrate the capacity correction factor due to the piping length for a standard indoor unit system at maximum load (with the thermostat set to maximum), under standard conditions.

Moreover, under partial load conditions, there is only a minor deviation for the capacity correction ratio, as shown in the above figures.

2. With this outdoor unit, the following control is used: - in case of cooling: constant evaporating pressure control - in case of heating: constant condensing pressure control

3. **Method of calculating the capacity of the outdoor units.**

The maximum capacity of the system will be either the total capacity of the indoor units or the maximum capacity of the outdoor units as mentioned below, whichever is less.

Indoor connection ratio ≤ 100%.

Maximum capacity of outdoor units = Capacity of outdoor units from capacity table at 100% connection ratio. × Correction ratio of piping to furthest indoor unit

Indoor connection ratio > 100%.

Maximum capacity of outdoor units = Capacity of outdoor units from capacity table at installed connection ratio. × Correction ratio of piping to furthest indoor unit

4. When the overall equivalent piping length is 90 m or more, the diameter of the main gas pipes (outdoor unit - branch sections) must be increased.
For the new diameters, see below.

Model	Standard liquid side Ø	Increased liquid side Ø	Standard gas side Ø	Increased gas side Ø
RXYSCQ6TMV1B	9,5	Not increased	19,1	22,2

5. Overall equivalent length


Overall equivalent length = Equivalent length of the main pipe × Correction factor + Equivalent length of the branch pipes

Choose the correction factor from the following table.

When calculating the cooling capacity: gas pipe size

When calculating the heating capacity: liquid pipe size

	Standard size	Size increase
Cooling (gas pipe)	1,0	0,5
Heating (liquid pipe)	1,0	0,5



Overall equivalent length

- Cooling mode = 80 m x 0,5 + 40 m = 80 m
- Heating mode = 80 m x 0,5 + 40 m = 80 m

Capacity correction ratio (height difference = 0)

- Cooling mode = 0,79
- Heating mode = 1,0


3D094660D

6 Dimensional drawings

6 - 1 Dimensional Drawings

6

RXYSCQ-TV1

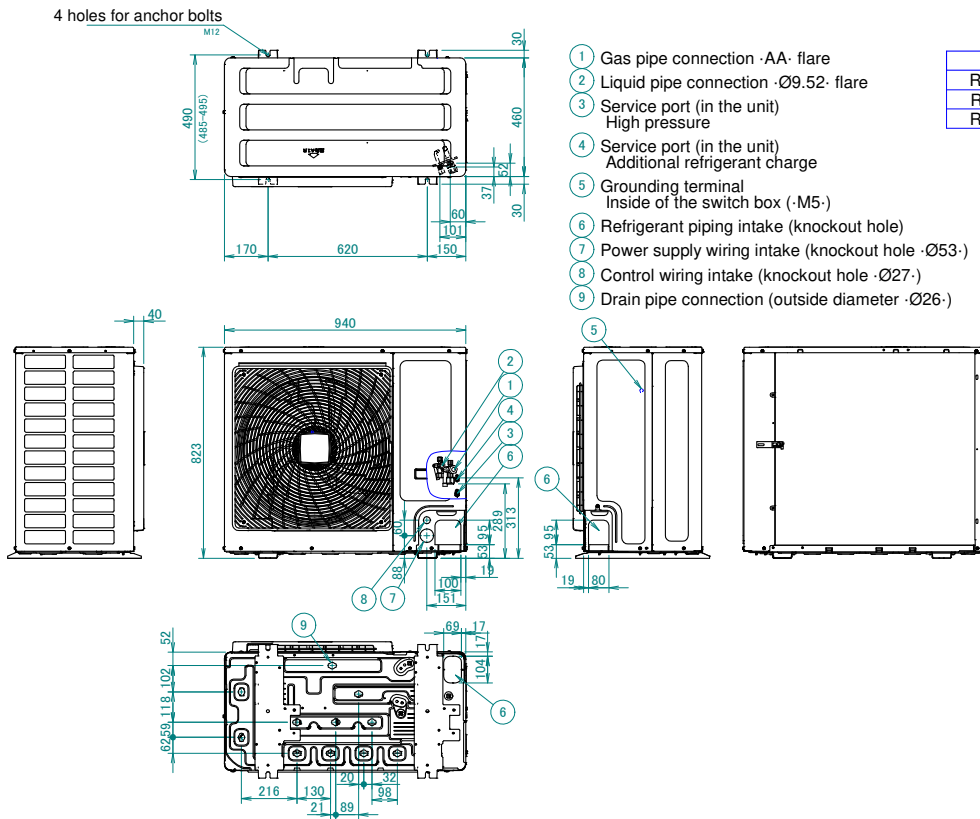


3D098107A

7 Centre of gravity

7 - 1 Centre of Gravity

RXYSCQ-TV1

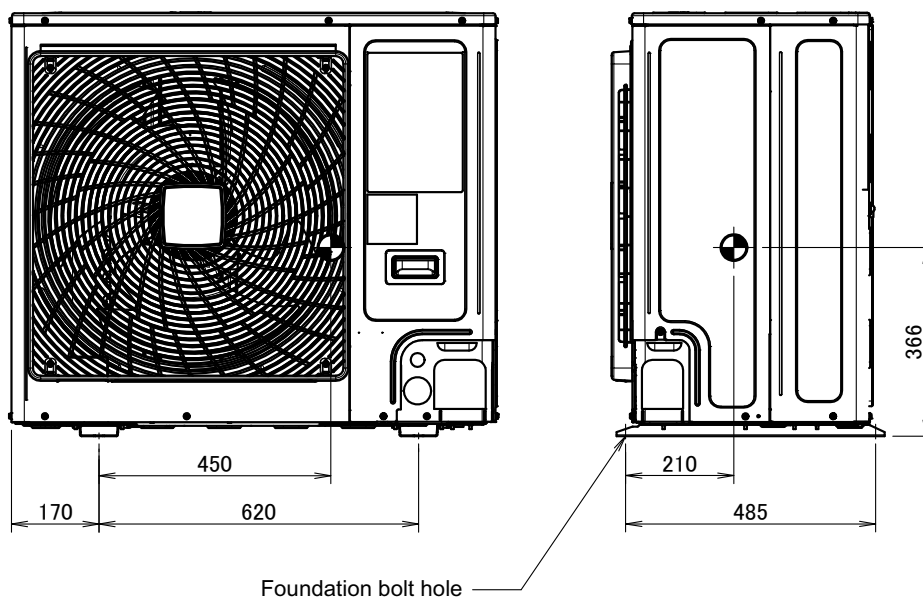


4D098083

8 Piping diagrams

8 - 1 Piping Diagrams

8

RXYSCQ-TV1

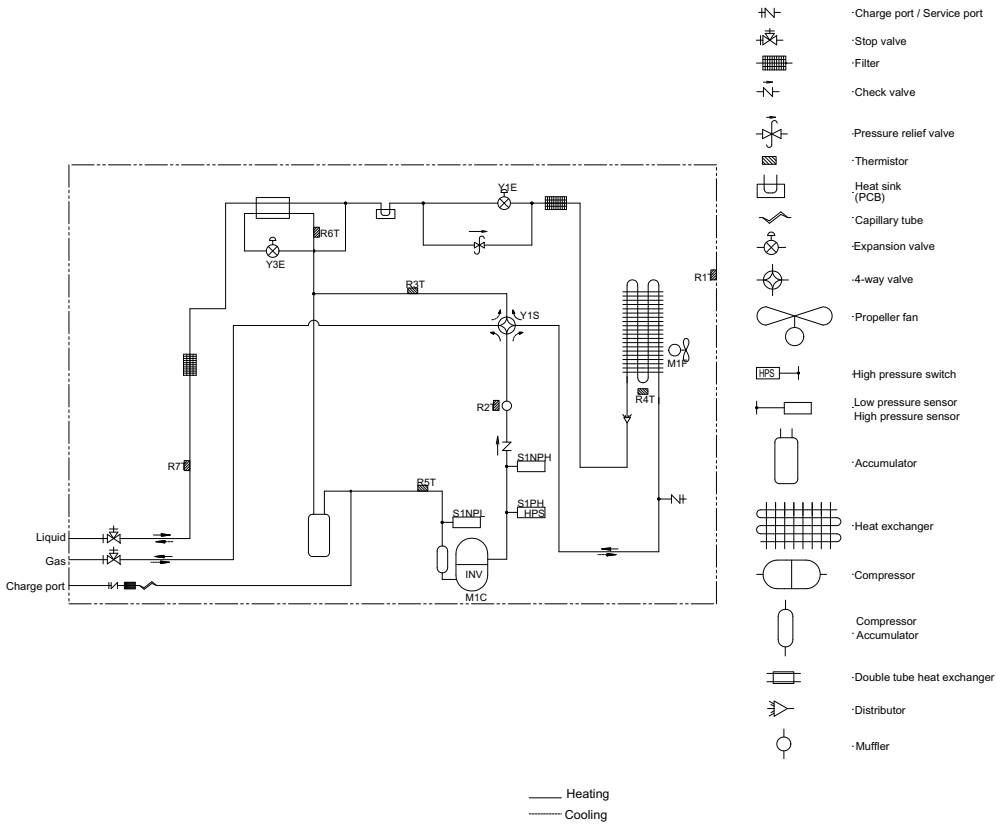


3D097886A

9 Wiring diagrams

9 - 1 Wiring Diagrams - Single Phase

RXYSCQ-TV1

- E1HC : Crankcase heater
- A1P : Printed circuit board (Main)
- A2P : Printed circuit board
- BS1-B5S : Push button switch
- C1 : Capacitor
- DS1 : Dip switch
- F1U : Fuse
- F3U : Fuse (T 6.3A / 250V)
- F4U : Fuse (T 6.3A / 250V)
- F6U : Fuse (T 5A / 250V)
- H1P-H8P : Pilot lamp (service monitor-orange) [H2P] Prepare, Test ----- Flickering
- HAP : Malfunction Detection - Light up
- HBP : Pilotlamp (service monitor - green)
- K11M : Magnetic contactor
- K1R : Magnetic relay (Y1S)
- K4R : Magnetic relay (E1HC)
- K1OR : Magnetic relay
- M1C : Motor (compressor)
- M1F : Motor (fan)
- PS : Switching power supply
- R1 : Resistor
- R2 : Resistor
- R1T : Thermistor (Air)
- R2T : Thermistor (Discharge)
- R3T : Thermistor (Suction 1)
- R4T : Thermistor (Heat exchanger)
- R5T : Thermistor (Suction 2)
- R6T : Thermistor (Subcooling H,Ex)
- R7T : Thermistor (Liquid pipe)
- F1NTH : Thermistor (Fin)
- S1NPH : Pressure sensor(High)
- S1NPL : Pressure sensor(low)
- S1PH : High pressure switch
- V1R : IGBT power module
- V2R : Diode module
- V1T-V3T : IGBT
- V1D-V3D : Diode
- L1R-L3R : Reactor
- X1M : Terminal strip
- X2M : Terminal strip
- Y1E : Electronic expansion valve
- Y3E : Electronic expansion valve
- Y1S : Solenoid valve (4 way valve)
- Z1C-Z7C : Noise filter (ferrite core)
- Z1F-Z5F : Noise filter
- X37A : Connector

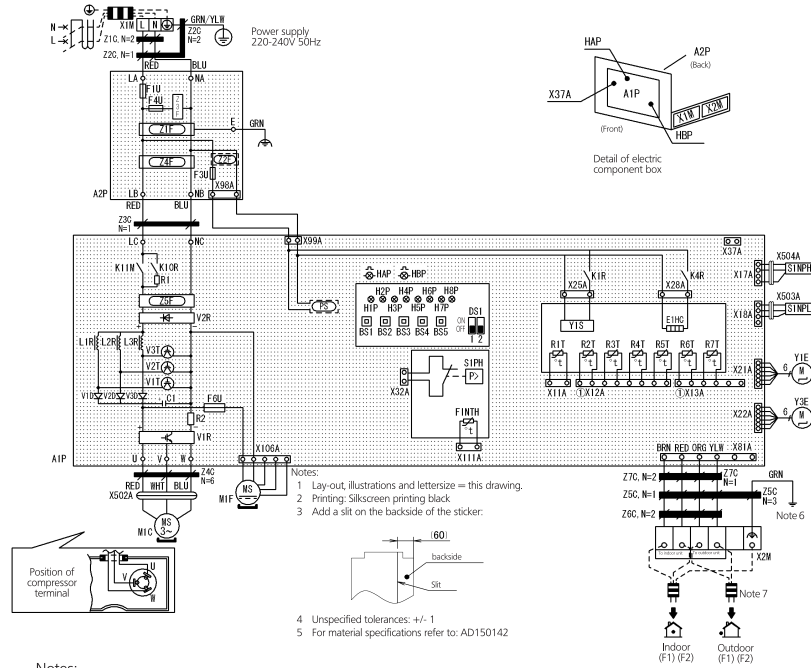

- Notes:
- 1 Lay-out, illustrations and letterize = this drawing.
 - 2 Printing: Silkscreen printing black
 - 3 Add a slit on the backside of the sticker.
-
- 4 Unspecified tolerances: +/- 1
 - 5 For material specifications refer to: AD150142

- Notes:
1. This wiring diagram only applies to the outdoor unit.
 2. [Symbol] : Field wiring [Symbol] : Terminal block, [Symbol] : Connector, [Symbol] : Movable connector, [Symbol] : Fixed connector, [Symbol] : Terminal, [Symbol] : Protective earth (screw), [Symbol] : Noiseless earth
 3. Refer to the installation manual on how to use BS1 - B5S and DS1, DS2 switch.
 4. When operating, do not short circuit for protection device. (S1PH)
 5. Colours: BLK: Black, RED: Red, BLU: Blue, WHT: White, GRN: Green, BRN: Brown, YLW: Yellow
 6. Refer to the installation manual for connection wiring to indoor-outdoor transmission F1 - F2.
 7. When using the central control system, connect outdoor-outdoor transmission F1-F2.

2D0943433E

10 External connection diagrams


10 - 1 External Connection Diagrams

10

RXYSCQ-TV1

External connection diagram


·VRV· indoor unit

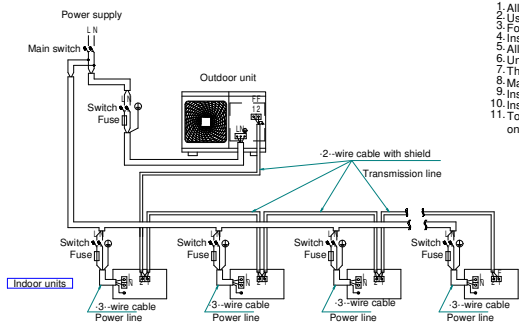


Notes

1. All wiring, components and materials to be procured on-site must comply with the applicable legislation.
2. Use copper conductors only.
3. For more details, refer to the wiring diagram of the unit.
4. Install a circuit breaker for safety.
5. All field wiring and components must be provided by an authorised electrician.
6. Unit has to be grounded in compliance with the applicable legislation.
7. The wiring shown is a general points-of-connection guide and is not intended to include all details for a specific installation.
8. Make sure to install the switch and the fuse to the power line of each equipment.
9. Install a main to switch to (if necessary) immediately interrupt all the system's power sources.
10. Install an earth leakage circuit breaker.
11. To ensure proper earthing, connect the shields of the incoming and outgoing transmission wiring of each indoor unit (or each ·BP· box, depending on the system layout) to each other.

·BP· box + ·RA/SA· indoor unit

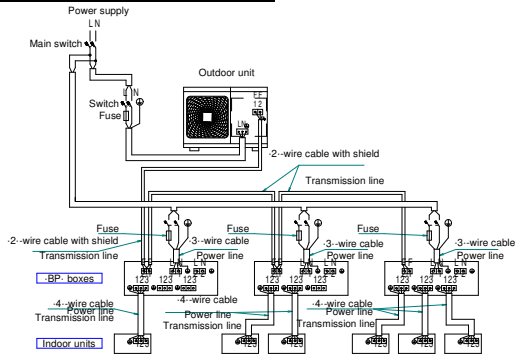

Power source is supplied to each ·BP· box individually.

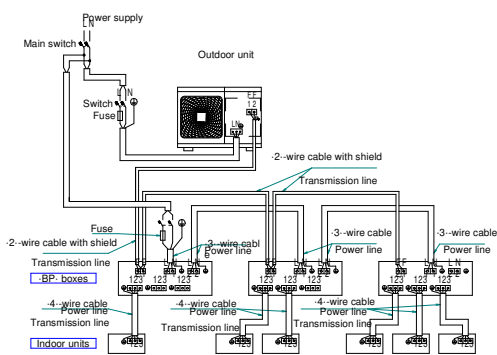


Power source is connected in series between the units.

1D094668

11 Sound data

11 - 1 Sound Power Spectrum


RXYSCQ4TV1

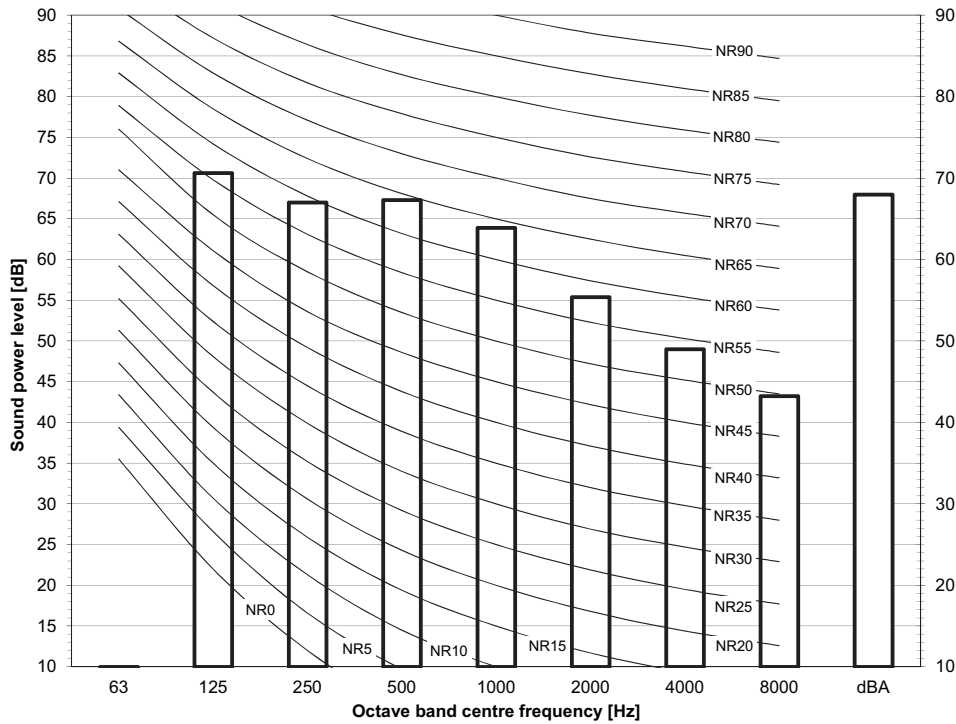

Notes
 - dBA = A-weighted sound power level (A scale according to IEC).
 - Reference acoustic intensity 0dB = 10E-6μW/m²
 - Measured according to ISO 3744

3D098238

RXYSCQ5TV1

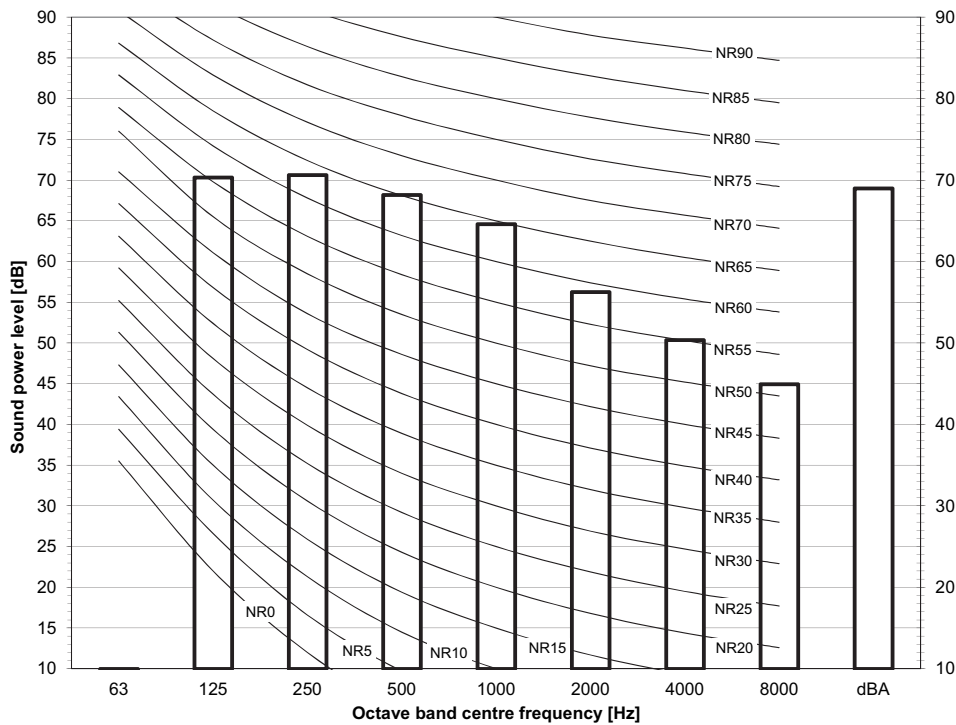


Notes
 - dBA = A-weighted sound power level (A scale according to IEC).
 - Reference acoustic intensity 0dB = 10E-6μW/m²
 - Measured according to ISO 3744

3D098239

11 Sound data

11 - 1 Sound Power Spectrum


11

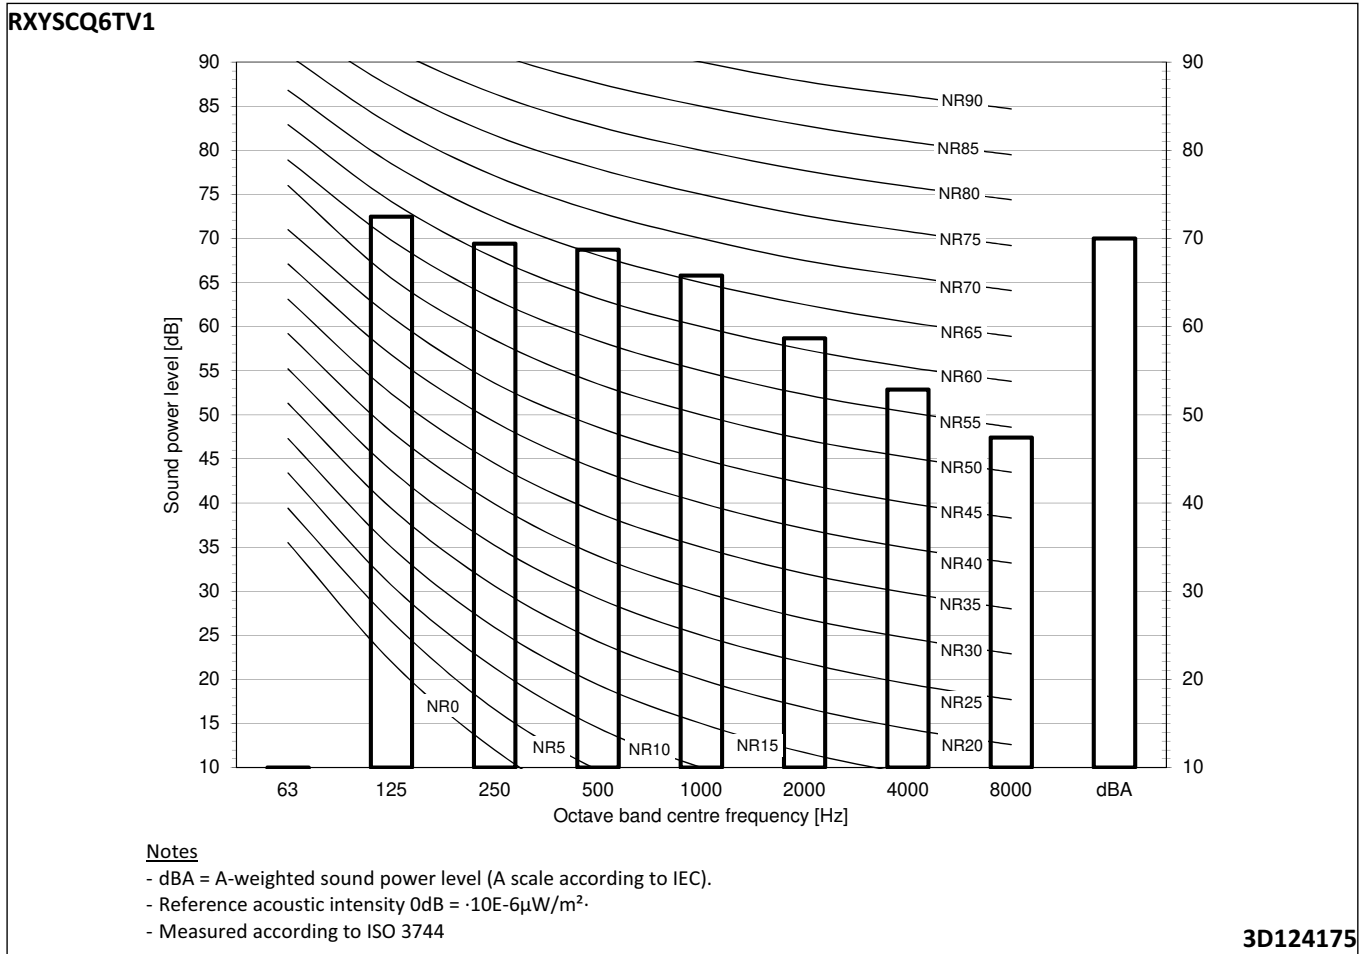


11 Sound data

11 - 2 Sound Pressure Spectrum

RXYSCQ4TV1

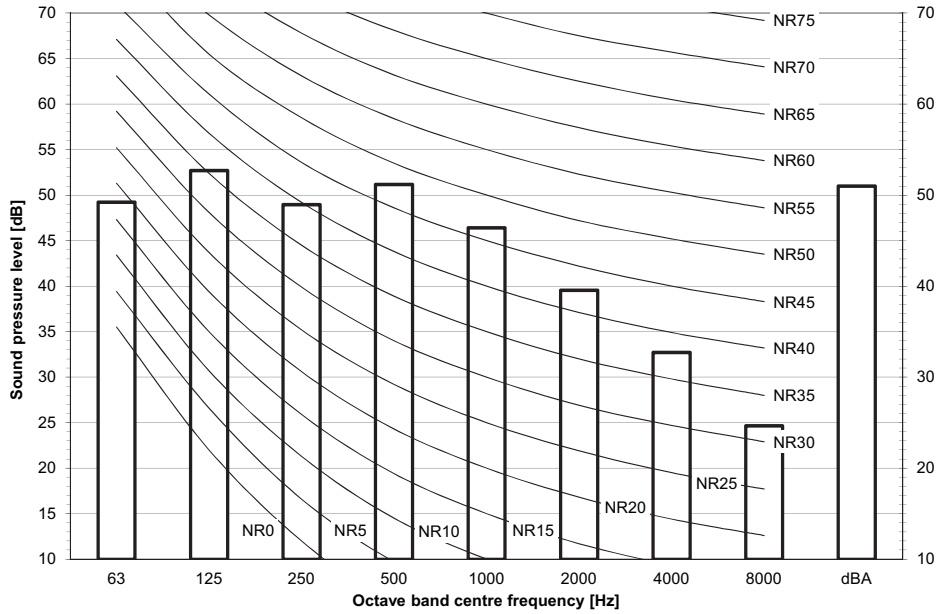


- Notes**
- Data is valid at free field condition.
 - Data is valid at nominal operation condition.
 - dBA = A-weighted sound pressure level (A scale according to IEC).
 - Reference acoustic pressure 0 dB = 20 µPa

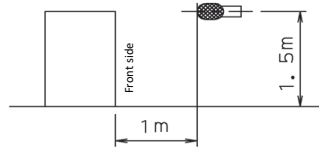


3D098243

RXYSCQ5TV1

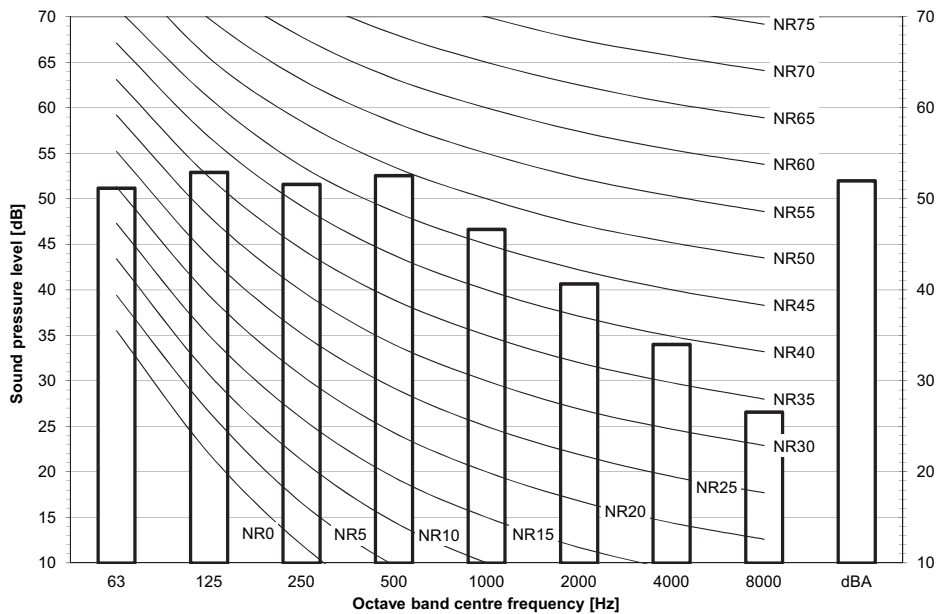

- Notes**
- Data is valid at free field condition.
 - Data is valid at nominal operation condition.
 - dBA = A-weighted sound pressure level (A scale according to IEC).
 - Reference acoustic pressure 0 dB = 20 µPa

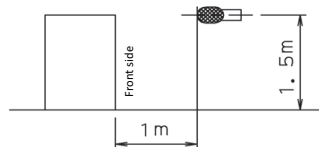


3D098244

11 Sound data

11 - 2 Sound Pressure Spectrum

11

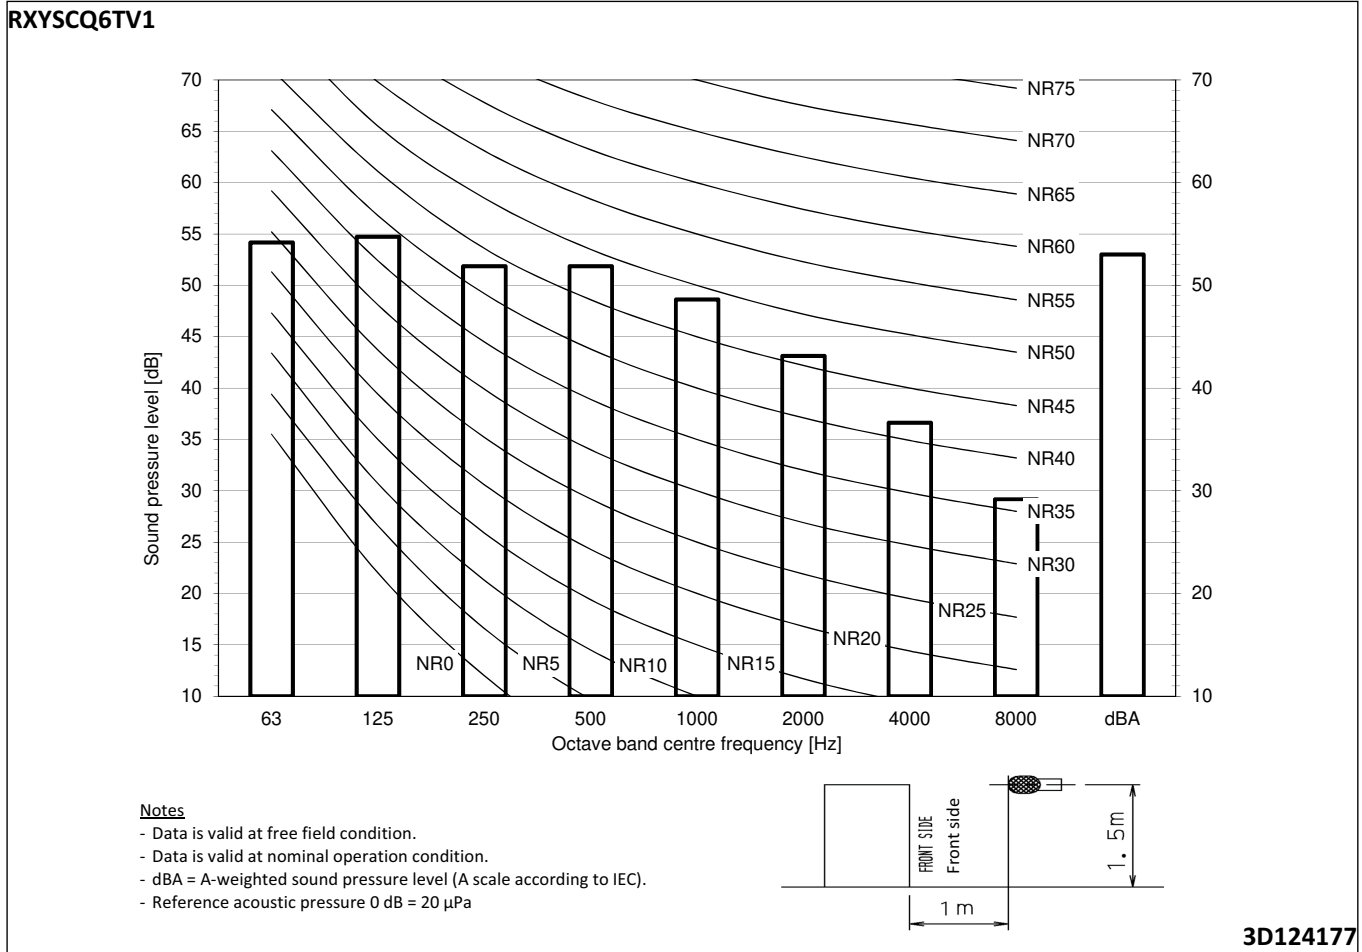

12 Installation

12 - 1 Installation Method

RXYSCQ-TV1


Required installation space

The unit of the values is mm.


(A) When there are obstacles on suction sides.

• No obstacle above


- ① Stand-alone installation
 - Obstacle on the suction side only



- Obstacle on both sides

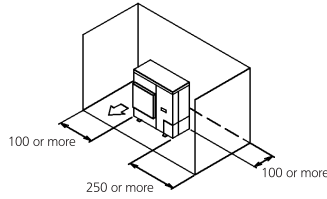


- ② Series installation (2 or more)
 - Obstacle on both sides

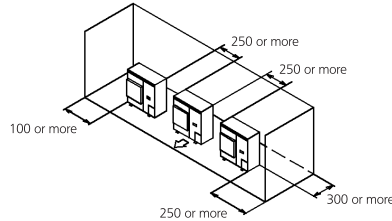


• Obstacle above, too.


- ① Stand-alone installation
 - Obstacle on the suction side, too



- Obstacle on the suction side and both sides

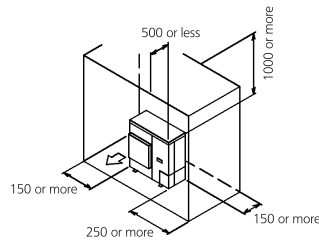


- ② Series installation (2 or more)
 - Obstacle on the suction side and both sides

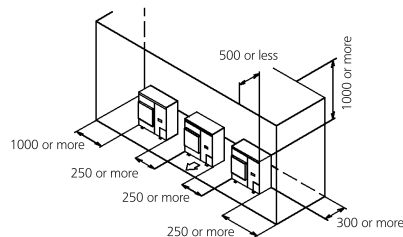


(B) When there are obstacles on discharge sides.

• No obstacle above

- ① Stand-alone installation




- ② Series installation (2 or more)

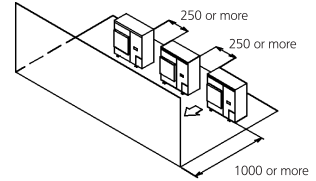


• Obstacle above, too

- ① Stand-alone installation



- ② Series installation (2 or more)

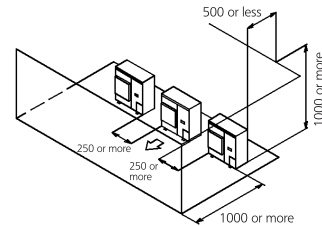


(C) When there are obstacles on both suction and discharge sides.

Pattern 1


When the obstacles on the discharge side is higher than the unit.
(There is no height limit for obstructions on the intake side.)

• No obstacle above

- ① Stand-alone installation

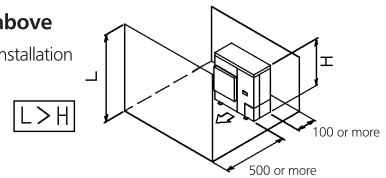

- ② Series installation (2 or more)

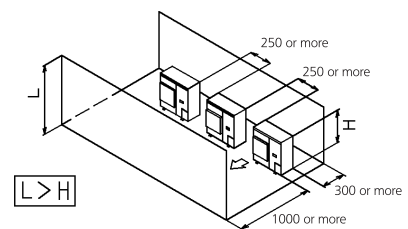

3D089310A

12 Installation

12 - 1 Installation Method

RXYSCQ-TV1


● Obstacle above, too

① Stand-alone installation

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	750
	$1/2 H < L \leq H$	1000
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.




② Series installation (2 or more)

The relations between H, A and L are as follows.


	L	A
$L \leq H$	$0 < L \leq 1/2 H$	1000
	$1/2 H < L \leq H$	1250
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed. Only two units can be installed for this series.

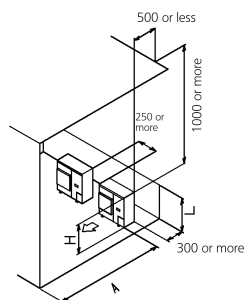

Pattern 2

When the obstacle on the discharge side is lower than the unit:
(There is no height limit for obstructions on the intake side.)

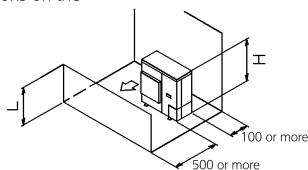


① Stand-alone installation

$L > H$

② Series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$0 < L \leq 1/2 H$		250
$1/2 H < L \leq H$		300

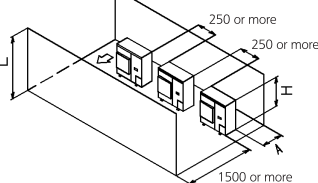


● Obstacle above, too

① Stand-alone installation

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	100
	$1/2 H < L \leq H$	200
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed.




② Series installation

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	250
	$1/2 H < L \leq H$	300
$H < L$	Set the stand as: $L \leq H$	

Close the bottom of the installation frame to prevent the discharged air from being bypassed. Only two units can be installed for this series.

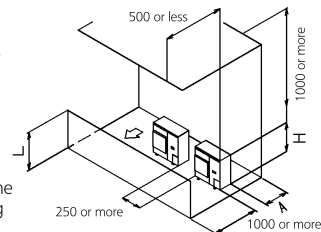


(D) Double-decker installation

① Obstacle on the discharge side.

Close the gap Z (the gap between the upper and lower outdoor units) to prevent the discharged air from being bypassed.


Do not stack more than two unit.



② Obstacle on the suction side.


Close the gap Z (the gap between the upper and lower outdoor units) to prevent the discharged air from being bypassed.

Do not stack more than two unit.



(E) Multiple rows of series installation (on the rooftop, etc.)


① One row of stand-alone installation

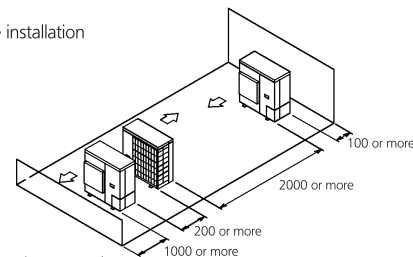

② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

	L	A
$L \leq H$	$0 < L \leq 1/2 H$	250
	$1/2 H < L \leq H$	300
$H < L$	Can not be installed	

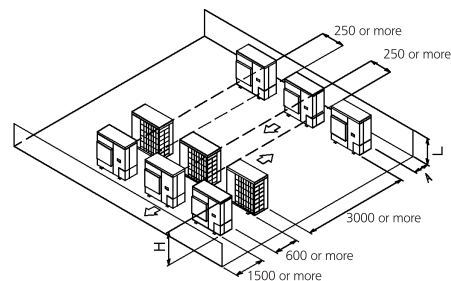

12 Installation

12 - 2 Refrigerant Pipe Selection

RXYSCQ-TV1

VRV4-S Heat pump Piping restrictions ·1/3·

For the reference drawing, see page ·2/3·.


		Maximum piping length		Maximum height difference		Total piping length
		Longest pipe (A+[B,D+E,H]) Actual / (Equivalent)	After first branch (B,D+E,H) Actual	Indoor-to-outdoor (H1) Outdoor above indoor / (indoor above outdoor)	Indoor-to-indoor (H2)	
Standard -VRV DX- indoor units only	RXYSCQ4~6TMV1B	70/(90)m	40m	30/(30)m	15m	300m
	RXYSQ4~6T7(V/Y)1B	120/(150)m	40m	50/(40)m	15m	300m
	RXYSQ4~6T8(V/Y)B	100/(130)m	40m	50/(40)m	15m	300m
	RXYSQ8TMY1B	120/(150)m	40m	50/(40)m	15m	300m
	RXYSQ10~12TMY1B	120/(150)m	40m	50/(40)m	15m	300m
-RA- connection	RXYSCQ4~6TMV1B	35/(45)m	40m	30/(30)m	15m	140m
	RXYSQ4~6T7(V/Y)1B	65/(85)m	40m	30/(30)m	15m	140m
	RXYSQ4~6T8(V/Y)B	80/(100)m	40m	30/(30)m	15m	140m
	RXYSQ8TMY1B	80/(100)m	40m	30/(30)m	15m	140m
	RXYSQ10~12TMY1B	80/(100)m	40m	30/(30)m	15m	140m
Air handling unit (-AHU-) connection	Pair	50/(55)m (1)	-	40/(40)m	-	-
	Multi (2)	50/(55)m (1)	40m	40/(40)m	15m	300m
	Mix (3)	50/(55)m (1)	40m	40/(40)m	15m	300m

- Notes**
- The allowable minimum length is ·5· m.
 - Multiple air handling units (-AHU-)(-EKEXV + ·EKEQ· kits).
 - Mix of air handling units (-AHU-) and -VRV DX- indoor units.

3D097984B

RXYSCQ-TV1

VRV4-S Heat pump Piping restrictions ·2/3·

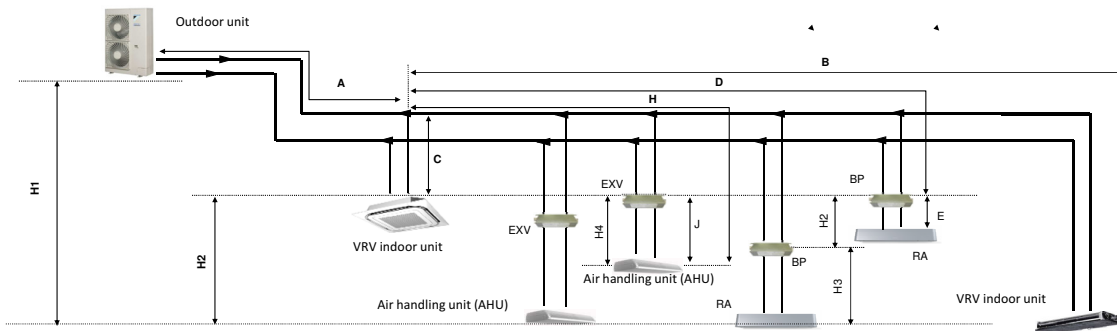

- Notes**
- Schematic indication
Illustrations may differ from the actual appearance of the unit.
 - This is only to illustrate piping length limitations.
Refer to combination table ·3D097983· for details about the allowed combinations.

		Allowed piping length		Maximum height difference	
		-BP- to -RA- (E)	-EXV- to -AHU- (J)	-BP- to -RA- (H3)	-EXV- to -AHU- (H4)
-RA- connection		2~15m	-	5m	-
Air handling unit (AHU) Connection	Pair	-	≤5m	-	5m
	Multi (1)	-	≤5m	-	5m
	Mix (2)	-	≤5m	-	5m

- Notes**
- Multiple air handling units (-AHU-)(-EKEXV + ·EKEQ· kits).
 - Mix of air handling units (-AHU-) and -VRV DX- indoor units.

3D097984B

12 Installation

12 - 2 Refrigerant Pipe Selection

12

RXYSCQ-TV1

VRV4-S
Heat pump
Piping restrictions 3/3

System pattern Allowed connection ratio (CR) Other combinations are not allowed.	Total		Allowed capacity		
	Capacity	Maximum allowed amount of connectable indoor units (-VRV, RA, AHU-) Excluding -BP- units and including -EXV- kits.	VRV DX indoor unit	-RA DX- indoor unit	Air handling unit (AHU)
-VRV DX- indoor units only	50~130%	Maximum -64-	50~130%	-	-
-RA DX- indoor units only	80~130%	Maximum -32- ⁽¹⁾	-	80~130%	-
-VRV DX- indoor unit + -AHU- Mix	50~110% ⁽³⁾	Maximum -64- ⁽²⁾	50~110%	-	0~110%
-AHU- only Pair + multi ⁽⁴⁾	90~110% ⁽³⁾	Maximum -64- ⁽²⁾	-	-	90~110%

Notes

1. There is no restriction on the number of connectable -BP- boxes.
2. -EKEXV- kits are also considered indoor units.
3. Restrictions regarding the air handling unit capacity
4. Pair AHU = system with 1 air handling unit connected to one outdoor unit
Multi AHU = system with multiple air handling units connected to one outdoor unit

About ventilation applications

- I. -FXMQ_MF- units are considered air handling units, following air handling unit limitations.
 - Maximum connection ratio when combined with -VRV DX- indoor units: -CR ≤ 30-%.
 - Maximum connection ratio when only air handling units are connected: -CR ≤ 100-%.
 - Minimum connection ratio when only -FXMQ_MF- units are connected: -CR ≥ 50-%
 For information on the operation range, refer to the documentation of the -FXMQ_MF- unit.
- II. -Biddle- air curtains are considered air handling units, following air handling unit limitations:
For information on the operation range, refer to the documentation of the -Biddle- unit.
- III. -EKEXV + EKEQ- units combined with an air handling unit are considered air handling units, following air handling unit limitations.
For information on the operation range, refer to the documentation of the -EKEXV-EKEQ- unit.
- IV. -VKM- units are considered to be regular -VRV DX- indoor units.
For information on the operation range, refer to the documentation of the -VKM- unit.
- V. Because there is no refrigerant connection with the outdoor unit (only communication F1/F2), -VAM- units do not have connection limitations.
However, since there is communication via F1/F2, count them as regular indoor unit when calculating the maximum allowed number of connectable indoor units.

3D097984B


13 Operation range

13 - 1 Operation Range

RXYSCQ-TV1
 RXYSQ-TV1
 RXYSQ4-6TY1

- Notes
1. These figures assume the following operation conditions
 Indoor and outdoor units
 Equivalent piping length: 5m
 Level difference: 0m
 2. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
 3. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
 4. Operation range is valid in case direct expansion indoor units are used.
 If other indoor units are used, refer to the documentation of the respective indoor units.
 5. If the unit is selected to operate at ambient temperatures <math>< -5^{\circ}\text{C}</math> for 5 days or more, with relative humidity levels >95%, it is recommended to apply a Daikin range specifically designed for such application.

For more information, contact your dealer.

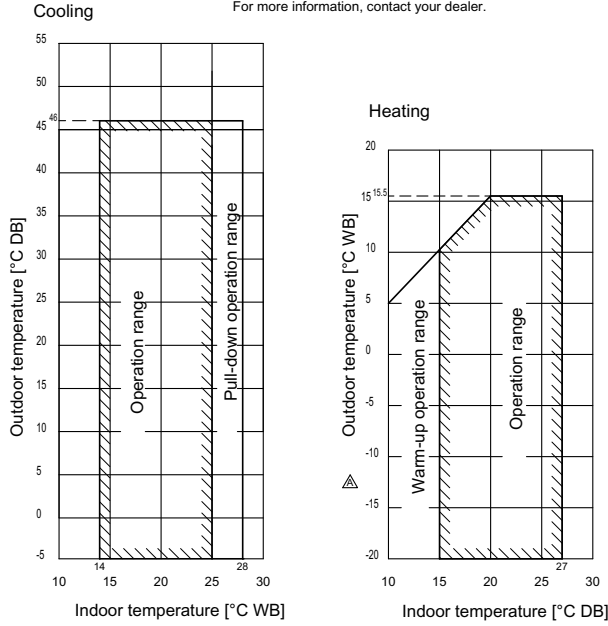

3D094664A

14 Appropriate Indoors

14 - 1 Appropriate Indoors

14

RXYSCQ-TV1

Recommended indoor units for ·RXYSQ*T* AND RXYSCQ*T*· outdoor units

· HP	4	5	6	8	10	12
	3xFXSQ25 1xFXSQ32	4xFXSQ32	2xFXSQ32 2xFXSQ40	4xFXMQ50	4xFXMQ63	6xFXMQ50

For details about the allowed combinations, see the engineering databook.

Appropriate indoor units for ·RXYSQ*T* AND RXYSCQ*T*· outdoor units

Covered by ·ENER LOT21·

- FXFQ20-25-32-40-50-63-80-100-125
- FXZQ15-20-25-32-40-50
- FXCQ20-25-32-40-50-63-80-125
- FXKQ25-32-40-63
- FXDQ15-20-25-32-40-50-63
- FXSQ15-20-25-32-40-50-63-80-100-125-140
- FXMQ50-63-80-100-125-200-250
- FXAQ15-20-25-32-40-50-63
- FXHQ32-63-100
- FXUQ71-100
- FXNQ20-25-32-40-50-63
- FXLQ20-25-32-40-50-63

Covered by ·ENER LOT10·

- FTXJ25-35-50
- FTXA20-25-35-42-50
- FTXM20-25-35-42-50-60-71
- CTXM15
- FLXS25-35-50-60
- FVXM25-35-50
- FVXG25-35-50
- FNA25-35-50-60
- FDXM25-30-50-60
- FFA25-35-50-60
- FCAG35-50-60-71
- FHA35-50-60-71
- FBA35-50-60-71


Outside the scope of ·ENER LOT21·

- EKEXV50-63-80-100-125-140-200-250 + EKEQM / EKEQF
- VKM50-80-100
- CYVS100-150-200-250
- CYVM100-150-200-250
- CYVL100-150-200-250

3D113977B



Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEEN19 10/19



Daikin Europe N.V. participates in the Eurovent Certified Performance programme for Liquid Chilling Packages and Hydronic Heat Pumps, Fan Coil Units and Variable Refrigerant Flow systems. Check ongoing validity of certificate: www.eurovent-certification.com



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.